



Department of the  
**Environment**

[www.doeni.gov.uk](http://www.doeni.gov.uk)

Planning and Natural Resources Division

# Planning and Environmental Policy Group

**Draft  
Planning Policy Statement 18  
Renewable Energy**

**Consultation Paper**

**23 November 2007**

## How to give your views

You are invited to send your views on this Draft Planning Policy Statement, PPS18 'Renewable Energy'.

Draft PPS 18 sets out the Department of the Environment's planning policy for development that generates energy from renewable resources. The PPS also contains policy provisions on the application of the principles of Passive Solar Design in new development. Comments should reflect the structure of the document as much as possible with references to paragraph numbers where relevant.

All responses should be made in writing and emailed to: [planning.policy@doeni.gov.uk](mailto:planning.policy@doeni.gov.uk) or sent by post to:

Stephen Hamilton  
PPS 18 Renewable Energy Consultation  
Planning and Environmental Policy Group,  
Department of the Environment  
12<sup>th</sup> Floor River House,  
48 High Street,  
BELFAST, BT1 2AW

### **The consultation period will end on Friday 21 March 2008**

Draft PPS18 is available on the Planning Service website: [www.planningni.gov.uk](http://www.planningni.gov.uk) or can be obtained by telephoning (028) 9054 7713, textphone at (028) 9054 0642 or by writing to the above address. Should you require a copy of this document in an alternative format, it can be made available on request in large print, disc, Braille or audiocassette. It may also be made available in minority languages for those who are not proficient in English.

In keeping with our policy on openness, the Department may make responses to this consultation document publicly available upon request.

At the end of the consultation period the Department will consider all comments received, following which the draft documents will be amended if necessary and, subject to Ministerial approval, published in final form.

# CONTENTS

Preamble .....	5
1.0 Introduction .....	7
2.0 Policy Context .....	9
3.0 Policy Objectives .....	12
4.0 Planning Policies .....	13
ANNEX 1 - Information and best practice guidance for renewable energy development proposals .....	27
A. WIND ENERGY .....	27
Introduction .....	27
Technology .....	28
Planning issues .....	35
Information to accompany a planning application .....	55
Other Authorisations/Consents .....	56
Consultees .....	56
B. BIOMASS .....	58
Introduction .....	58
Technology .....	59
Planning issues .....	68
Information to accompany a planning application .....	68
Other Authorisations/Consents .....	69
C. ENERGY FROM WASTE (biological processes) .....	70
Introduction .....	70
Technology .....	71
Planning issues .....	77
Information to accompany a planning application .....	80
Other Authorisations/Consents .....	81
D. ENERGY FROM WASTE (Thermal processes) .....	82
Introduction .....	82
Technology .....	83
Planning issues .....	86
Information to accompany a planning application .....	87
Other Authorisations/Consents .....	88
E. SMALL HYDRO .....	89
Introduction .....	89
Technology .....	89

Planning issues .....	91
Information to accompany a planning application .....	94
Other Authorisations/Consents .....	95
F.    ACTIVE SOLAR (Photovoltaics) .....	96
Introduction .....	96
Technology.....	96
Planning issues .....	98
Information to accompany a planning application .....	99
G.    SOLAR THERMAL (Solar Water Heating) .....	100
Introduction .....	100
Technology.....	100
Planning issues .....	102
Information to accompany a planning application .....	103
H.    GROUND, WATER AND AIR SOURCE HEAT PUMPS .....	105
Introduction .....	105
Technology.....	105
Planning issues .....	106
ANNEX 2 - Passive Solar Design .....	109
Introduction.....	109
Technology .....	109
Planning issues .....	111
Information to accompany a planning application.....	112
Other Authorisations/Consents.....	113
ANNEX 3 - Community benefits arising out of the development of windfarms and other large scale renewable energy projects in Northern Ireland.....	115
1.    Planning Agreements.....	115
2.    Community benefits – outside of the planning process.....	115
3.    Case studies .....	116
ANNEX 4 – Stakeholder organisations .....	121
ANNEX 5 – Screening for Equality Impact Assessment Draft Planning Policy Statement 18 ‘Renewable Energy’ .....	123

## Preamble

The Department of the Environment (the Department) is responsible for planning control in Northern Ireland. The Planning Service, an Agency within the Department, administers its planning functions. The Department of Finance and Personnel have responsibility for the building regulations, and the Department of Enterprise, Trade and Investment (DETI), is responsible for Energy.

The Department has a statutory duty, laid down in Article 3 of the Planning (Northern Ireland) Order 1991, to formulate and co-ordinate policy for securing the orderly and consistent development of land and the planning of that development. The Department is required to ensure such policy is in general conformity with the Regional Development Strategy.

The Department's planning policies are normally issued through Planning Policy Statements (PPS) and PPS 1 'General Principles' advises that:

*"Planning Policy Statements set out the policies of the Department on particular aspects of land-use planning and apply to the whole of Northern Ireland. Their contents will be taken into account in preparing development plans and are also material to decisions on individual planning applications and appeals."*

This Planning Policy Statement, PPS 18 'Renewable Energy' sets out the Department's planning policy for development that generates energy from renewable resources. The PPS also contains policy provisions on the application of the principles of Passive Solar Design in new development. It embodies the Government's commitments to: sustainable development; reducing emissions; and a move from being an overly fossil fuel reliant economy to one which seeks to maximise on the Region's substantial renewable energy potential.

The Department was assisted by an external stakeholder group in bringing forward this PPS (see Annex 4) and would like to take this opportunity to thank individuals for their participation to date.

**When issued in final form, the policies of this Statement will supersede Policy PSU 12 'Renewable Energy' of the Planning Strategy for Rural Northern Ireland. Where the above policy is referred to elsewhere in the Planning Strategy, the policies of this statement will take precedence. The policies of this PPS do not apply to off-shore renewable energy development as these are not subject to control under the land use planning system.**

The PPS has been subjected to an equality impact screening exercise in line with the statutory obligation contained in Section 75 of the Northern Ireland Act 1998. The outcome of this exercise indicates that the PPS is unlikely to have significant adverse implications for equality of opportunity or community relations.

Nothing in this document should be read as a commitment that public resources will be provided for any specific project. All proposals for expenditure by the Department are subject to economic appraisal and will also have to be considered having regard to the overall availability of resources.

## 1.0 Introduction

- 1.1 The Government has accepted that long-term climate change is the single biggest environmental threat facing the planet. Climate change refers to the variation in the Earth's global climate or in regional climates over time through the build up of greenhouse gases<sup>1</sup> in the atmosphere that effect changes in rainfall patterns, increase flood risk, sea levels, habitat loss, heat stress, and potential droughts.
- 1.2 The Intergovernmental Panel on Climate Change (IPCC) Fourth Assessment Report describes progress in understanding of human and natural drivers of climate change. The IPPC report acknowledges that global atmospheric concentrations of greenhouse gases have increased markedly as a result of human activity, with global increases in carbon dioxide (CO<sub>2</sub>) concentration due primarily to the use of fossil fuels. The report further suggests that 30 per cent of the projected CO<sub>2</sub> emissions from residential and commercial buildings could be avoided through greater use of Passive Solar Design and better insulation as well as high-efficiency lighting, appliances and heating/cooling systems.
- 1.3 The main source of CO<sub>2</sub> emissions in the UK comes from the burning of fossil fuels in power stations. To help lessen the effects of climate change, the Government has committed to reducing the level of greenhouse gases emitted. Emphasis is being given to energy generation from sources that emit low or even zero levels of greenhouse gases, such as renewable energy, and through using energy as efficiently as possible.
- 1.4 Renewable energy comes from energy sources that are continuously replenished by nature. The main sources of renewable energy are the wind, the sun (solar energy), moving water (hydropower), heat extracted from the air, ground and water (geothermal energy), and biomass (wood, biodegradable waste and energy crops) – further information on current renewable energy technologies is set out in Annex 1.
- 1.5 An increase in renewable electricity and heat generation as a means of reducing greenhouse gases and in particular CO<sub>2</sub> forms an important part of Northern Ireland's efforts to tackle climate change. More renewables can also provide greater diversity in our energy mix. Using indigenous renewable sources of energy will reduce our dependence on imported fossil fuels and will bring diversity and security of supply to the Region's energy infrastructure.

---

<sup>1</sup> Atmospheric gases such as carbon dioxide, methane, and nitrous oxide that regulate the Earth's atmospheric temperature by absorbing infrared radiation.

- 1.6 As well as assisting in countering the effects of climate change, using renewable energy will also help to reduce other forms of environmental and social damage arising from the use of fossil fuels. For example, it will help reduce the impact of acid rain on water and forest ecosystems, and reduce localised air pollution and its subsequent health impacts.
- 1.7 The varied nature of renewable energy technologies presents the potential to develop an indigenous renewable energy industry and provides a range of opportunities to support the local economy including:
- direct and indirect employment opportunities during the construction and operational phases;
  - revenue to the owners of the land on which they are built;
  - employment in the manufacture of components and services
  - opportunities for rural diversification, the alternative agricultural use of land and employment in the production of biomass crops;
  - a beneficial route for the utilisation of residues and wastes that might otherwise be difficult or expensive to dispose of; and
  - an improved source of electricity in remote locations.
- 1.8 The primary aim of this Planning Policy Statement (PPS) is to encourage and facilitate the provision of renewable energy and heat generating facilities in appropriate locations within the built and natural environment. The PPS also promotes greater application of the principles of Passive Solar Design in the design, siting and layout of new development.

## **2.0 Policy Context**

### **Climate Change**

- 2.1 In December 1997, the United Nations Framework Convention on Climate Change (the Kyoto Protocol) was signed by 171 countries including the UK. Under this protocol, the European Union (EU) has a commitment to an 8% reduction of greenhouse gas emissions on 1990 levels by 2010.
- 2.2 The UK agreed to contribute to this target with a 12½% cut in its emissions. Moreover, the UK government set itself an even more challenging domestic target of a 20% reduction in CO<sub>2</sub> emissions below its 1990 levels by 2010. The Kyoto Protocol came into operation on 16 February 2005.
- 2.3 Complementing this, the EU Renewables Directive (2001/77/EC) focuses on measures to encourage the promotion of electricity from renewable sources. This seeks to ensure that the overall EU indicative target of 12% of gross energy consumption (22% of electricity consumption) to be produced from renewable energy sources is met by 2010.
- 2.4 The Northern Ireland Renewables Obligation is the main policy mechanism for promoting the generation of electricity from renewable sources in line with the Renewables Directive. As such it supports international commitments to address climate change by reducing emissions of greenhouse gases into our atmosphere. It also addresses the need to reduce Northern Ireland's high dependency on imports of increasingly scarce fossil fuels.
- 2.5 On 9 March 2007 the European Council of Ministers backed Commission proposals on energy and climate change, agreeing on an action plan to put in place a European energy policy by 2009. The most significant progress was achieving agreement on a binding target to reduce EU greenhouse gas emissions by 20% by 2020. In addition this binding target would increase to a 30% reduction should other industrialised nations, including the US, agree to take similar steps through international negotiations for a post-Kyoto agreement.
- 2.6 The UK Government published the draft Climate Change Bill on 13 March 2007. This Bill sets ambitious targets beyond those agreed by Europe in setting legally binding targets to reduce carbon emissions by between 26% and 32% by 2020, and 60% by 2050, from 1990 levels.

### **Regional Development Strategy**

- 2.7 The Regional Development Strategy for Northern Ireland 2025 (RDS) acknowledges that the effects of climate change will have implications for lifestyles and the form of development in the future and indicates

that strategic planning, to deal with key impacts that may arise from climate change, will be more cost effective than taking retrospective action.

- 2.8 An objective of the Strategy is to contribute to reducing the impact of global warming, both locally and globally, and to emphasise the importance of cutting environmental costs generally, by reducing the consumption of natural resources and energy from non-renewable sources.
- 2.9 A number of specific measures contained within supporting actions to the Strategic Planning Guidelines include:
- promotion of the development of renewable energy resources (RNI 1.1);
  - promote a wider choice of energy supply, including the use of renewable energy to respond to the implications of climate change and promote more prudent and efficient use of energy and resources (ENV 5);
  - promote the use of cleaner and more efficient fossil fuels and the exploitation of renewable sources of energy and alternative energy technology (ENV5.3).

## **Energy Policy**

- 2.10 In recent years, United Kingdom energy policy has been promoting the use of renewable energy. The DETI publication, 'Energy: a Strategic Framework for Northern Ireland', June 2004, promotes reduced energy consumption combined with improved energy efficiency. A policy goal of the framework is enhancing sustainability in energy. The framework highlights the potential for renewable forms of energy to enhance security and diversity of supply and to minimise the environmental implications of electricity generation. It sets a target of 12% for the amount of Northern Ireland's electricity consumption that is to be generated from indigenous renewable sources by 2012.
- 2.11 The Energy Challenge Energy Review Report published by the Department of Trade and Industry in July 2006 sets out the steps government needs to take in responding to the energy challenges facing the United Kingdom. The report recognises renewable energy as an integral part of the Government's strategy for tackling climate change and proposes a range of measures to promote its growth to achieve 20% of electricity generation from renewable sources by 2020.

## **Sustainable Development Strategy**

- 2.12 First Steps Towards Sustainability – A Sustainable Development Strategy for Northern Ireland, May 2006 (SDS) recognises that the Region has enormous potential to develop renewable energy sources as alternatives to burning coal, oil or gas. A priority of the SDS is to foster opportunities and build on the existing successes and abilities of

companies in Northern Ireland to develop innovative ideas and new technologies in this field.

- 2.13 The SDS contains challenging targets for the Region above those set at national and international levels for the reduction of greenhouse gas emissions and indicates important steps towards achieving these targets. These include ensuring that where technologically and economically feasible, beyond 2025, 40% of all electricity consumed in Northern Ireland is obtained from indigenous renewable energy sources with at least 25% of this being generated by non-wind technologies.
- 2.14 The SDS contains three strategic objectives on climate change and energy namely:
- to reduce greenhouse gas emissions, principally by promoting energy efficiency and the use of renewables;
  - to establish Northern Ireland as a world class exemplar in the development and use of renewable energy; and
  - to plan and prepare for climate change impacts in Northern Ireland.
- 2.15 The Implementation Plan for the SDS, was published in November 2006 and details the current actions being taken by government, and puts forward a series of commitments to meet the Strategy target of achieving a 25% reduction in Northern Ireland's greenhouse gas emissions against 1990 levels by 2025.

### **Other Government Strategies**

- 2.16 In preparing this PPS, consideration has also been given to a number of other Government Strategies including the Northern Ireland Biodiversity Strategy (2002) published by the Northern Ireland Executive; the Department's Waste Management Strategy 2006-2020; and the Department for Agriculture and Rural Development Action Plan for a Renewable Energy Policy.

### **3.0 Policy Objectives**

3.1 The primary aim of this Statement is to encourage and facilitate the provision and siting of renewable energy generating facilities in appropriate locations within the built and natural environment. The main objectives behind the policies are:

- to contribute to the alleviation of climate change through reducing greenhouse gas emissions;
- to contribute to the regional target of 12% of electricity generation by 2012, and 40% by 2025 from renewable energy sources;
- to assist the diversification of energy supply and a more competitive energy market;
- encourage economic growth and rural diversification associated with the development of an indigenous renewable energy industry;
- to ensure that the environmental, landscape, visual and amenity impacts associated with renewable energy development are adequately addressed;
- to ensure appropriate protection of the Region's built and natural, and cultural heritage features;
- to promote knowledge of and greater acceptance by the public of prospective renewable energy developments that are appropriately located;
- to foster greater community involvement in renewable energy projects and encourage use of community benefits; and
- promote greater application of the principles of Passive Solar Design in the design, siting and layout of new development.

## **4.0 Planning Policies**

**In exercise of its responsibility for planning control in Northern Ireland the Department assesses development proposals against all planning policies and other material considerations that are relevant to it.**

**The planning policies of this Statement must therefore be read together and in conjunction with the relevant contents of the existing development plans, other planning policy publications, including the Regional Development Strategy, and regard given to the contents of supplementary planning guidance documents.**

**The following policies set out the main considerations that the Department will take into account in assessing proposals for renewable energy and heat generating facilities. They also deal with the integration of renewable energy into buildings and the application of Passive Solar Design principles in new development. The provisions of these policies will prevail unless there is other overriding policy or material considerations that outweigh them and justify a contrary decision.**

## **Policy RE 1**

### **Renewable Energy Development**

**Development that generates energy from renewable resources will be permitted provided the proposal, and any associated buildings and infrastructure (including transmission lines), would not result in an unacceptable adverse impact on:**

- (a) public safety; human health; or residential amenity;**
- (b) visual amenity and landscape character;**
- (c) biodiversity, nature conservation or built heritage interests;**
- (d) local natural resources, including air and water quality; and**
- (e) public access to the countryside.**

**Proposals will be expected to be located at, or as close as possible to, the source of the resource needed for that particular technology, unless, in the case of a Combined Heat and Power scheme, it can be demonstrated that the benefits of the scheme outweigh the costs of transportation and an end user is identified.**

**Applications for renewable energy development will be expected to be accompanied by an appropriate detailed statement of the environmental effects of the proposal, and for any larger scale project, its benefits in terms of the amount of energy it is anticipated to generate.**

**Certain development, depending on its scale or location may require an Environmental Impact Assessment and in addition where a proposal would be likely to have a significant effect on a Site of International Nature Conservation Importance, the developer will need to submit such information as required by the competent authority to carry out an Appropriate Assessment.**

**Permission will only be granted if any unavoidable damage that would be caused during installation, operation (or in the case of windfarms, decommissioning) is minimised and mitigated, and where necessary, compensated for.**

**The wider environmental, economic and social benefits of all proposals for renewable energy projects, whatever their scale, are material considerations that will be given significant weight in determining whether planning permission should be granted.**

**In addition developers of major windfarms and other large scale renewable energy projects will be encouraged to provide Community Benefits outside the planning process.**

**The information and best practice guidance for all forms of renewable**

energy development set out in Annex 1 will be taken into account in assessing proposals.

### **Wind Energy Development**

Applications specifically for wind energy development will also be required to demonstrate all of the following:

- (i) that the development will not have an unacceptable impact on visual amenity or landscape character through: the number, scale, size and siting of turbines; or the need for new transmission lines for connection to the electricity supply grid;
- (ii) that the development will not impact significantly on peatland carbon stores if sited in or near a peatland habitat;
- (iii) that the development has taken into consideration the cumulative impact of neighbouring wind turbines or wind farm development, existing or approved;
- (iv) that no part of the development will give rise to unacceptable electromagnetic interference to communications installations; radar or air traffic control systems; emergency services communications; or other telecommunication systems;
- (v) that no part of the development will have an unacceptable impact on roads, rail or aviation safety;
- (vi) that the development will not cause significant harm to the safety or amenity of the users of any regularly occupied building arising from noise; shadow flicker; ice throw; and reflected light; and
- (vii) that above-ground redundant plant (including turbines), buildings and associated infrastructure shall be removed and the site restored to an agreed standard appropriate to its location.

In addition to the information and best practice guidance set out in Annex 1, supplementary guidance on the sensitivity of the Region's landscapes to wind energy development is currently in preparation and will also be taken into account in assessing proposals.

## **Justification and Amplification**

- 4.1. Increased development of renewable energy resources is vital to facilitating the delivery of the Government's commitments on both climate change and renewable energy. The Department will therefore support renewable energy proposals unless they would have adverse effects which are not outweighed by the local and wider environmental, economic and social benefits of the development. This includes wider benefits arising from a clean, secure energy supply; reductions in greenhouse gases and other polluting emissions; and contributions

towards meeting the Region's target for use of renewable energy sources.

- 4.2. This policy is intended to apply to all renewable energy technologies. Such technologies can be used at different scales ranging from those which contribute to the national grid, to micro-generation schemes which serve one property. Renewable resources can be used to supply Combined Heat and Power Schemes (CHP) to serve groups of properties, including housing schemes. It is acknowledged that technologies are constantly being researched and developed. Developments utilising other renewable technologies, not presently viable, but which become viable will also be assessed against the requirements of Policy RE1.
- 4.3. Development proposals should demonstrate any environmental, economic and social benefits as well as how any environmental and social impacts have been minimised through careful consideration of location, scale, design and other measures.

#### *Natural and Built Heritage Considerations*

- 4.4. Planning permission for renewable energy developments likely to have a significant effect on a Site of International Nature Conservation Importance<sup>2</sup> or a World Heritage Site will only be granted once an assessment has shown that the integrity of the site would not be adversely affected.
- 4.5. If the renewable energy development would have, or is likely to have an adverse effect on the integrity of a Site of International Nature Conservation Importance, planning permission will only be granted where there is no alternative solution and there are imperative reasons of overriding public interest, including those of a social or economic nature.
- 4.6. In addition, where a Special Area of Conservation hosts a priority habitat or species<sup>3</sup> and there are no alternative solutions, development will not be permitted unless it is necessary for reasons of human health, public safety, or a beneficial consequence of primary importance to the environment, or to other reasons which in the opinion of the Department, having considered the opinion of the European Commission, are imperative reasons of overriding public interest. Where planning permission is permitted on or affecting any site of international nature conservation importance, appropriate compensatory measures are required.

---

<sup>2</sup> Special Protection Areas (including potential SPAs), Special Areas of Conservation (including candidate SACs), Sites of Community Importance and Ramsar Sites

<sup>3</sup> Priority habitats and species are defined in annexes 1 and 2 of the EC Council Directive 92/43/EEC on the Conservation of Natural Habitats and Wild Fauna and Flora

- 4.7. Where development with an adverse effect on the integrity of a Site of International Nature Conservation Importance is considered necessary because of the lack of alternative solutions and imperative reasons of overriding public interest, compensatory measures will need to be put in place to ensure the overall coherence of the network of international sites is protected. This will require the new habitats to be fully ecologically functional before the predicted adverse effects occur.
- 4.8. Planning permission for renewable energy projects in sites with national/regional designations for natural or built heritage interests (Areas of Special Scientific Interest; Areas of Scientific Interest; National Nature Reserves; National Parks; Areas of Outstanding Natural Beauty; Monuments in State Care and Scheduled Monuments; Conservation Areas; Listed Buildings; and Historic Parks, Gardens and Demesnes) will only be granted where it can be demonstrated that the objectives of the designation will not be compromised by the development, or are clearly outweighed by the environmental, economic and social benefits of the proposal.
- 4.9. For renewable energy proposals affecting local designations such as an Area of Townscape Character or a Site of Local Nature Conservation Importance planning permission will be granted provided there is no significant adverse effect on the designation.
- 4.10. In all cases careful consideration will be given to the scale, siting, design and layout of the proposal. The significance of environmental effects may depend on the type and scale of the renewable energy development and the sensitivity of the location. As the sensitivity of location between and within different designated areas can vary, each proposal will be assessed against the specific reason for designation, taking into account uniqueness, beauty, and character of landscape, habitat and species, physiographic, geological, heritage and cultural features. Policy relating to these matters is set out in the Department's Planning Policy Statement 2 Planning and Nature Conservation (currently under review), and Planning Policy Statement 6 Planning Archaeology and the Built Heritage.
- 4.11. Where a renewable energy development is likely to have an adverse effect on the natural heritage or nature conservation interests, the Department will require developers to bring forward mitigation measures, and where appropriate the scope for compensatory measures may be considered. Further information on this matter is set out in PPS 2 Planning and Nature Conservation.

#### *Active Peatland*

- 4.12. Active peatland, comprising blanket and raised bog, is identified as a priority habitat for Europe in Annex 1 of the EC Council Directive 92/43/EEC on the Conservation of Natural Habitats and Wild Fauna and Flora. Active peatland sequesters carbon from the atmosphere and stores it over long periods of time

- 4.13. The cutting and drainage associated with the development of, in particular, wind turbines and their associated infrastructure, has the potential to severely impact on the hydrology of a large area of active bog, with the ensuing release of the carbon stored therein. Any development on active peatland will not be permitted unless it is necessary for reasons of human health, public safety, or a beneficial consequence of primary importance to the environment, or to other reasons which in the opinion of the Department, having considered the opinion of the European Commission, are imperative reasons of overriding public interest.
- 4.14. Where the hydrology of other peatland sites has been negatively impacted upon through previous interventions, measures may be taken to restore such areas to active peatland. In promoting mitigation/compensatory measures for renewable energy developments the Department may require developers to restore areas to active peatland that are within or adjacent to the development site.

#### *Technology appropriate location*

- 4.15. Renewable energy resources, such as hydro or wind, can usually only be developed where they occur and some degree of impact may be unavoidable. In relation to wind energy, this can only be exploited where wind speeds are sufficiently fast. By its very nature the wind resource is likely to be greatest in upland areas, which may be particularly sensitive in terms of their landscape and nature conservation value. It is also recognised that larger-scale wind energy developments are likely to be visible over distances. However, the impacts associated with such forms of renewable energy development may be considered acceptable for example because they are minor or because mitigation measures may be put in place.
- 4.16. Technologies which are not site specific e.g. those which involve the combustion or breakdown of materials such as wood waste will, additionally, be expected to be located as close as possible to the source of the material in order to ensure that transportation of such materials is minimised. A possible exception to this would be where a Combined Heat and Power scheme necessitates its location close to the user of the heat and/or energy, in which case the applicant will be expected to demonstrate that the benefits of such a scheme outweigh the transportation costs involved.

#### *Landscape and Visual Effects of Renewable Energy Development*

- 4.17. The landscape and visual effects of particular renewable energy developments will vary on a case by case basis according to the type of development, its location and the landscape setting of the proposed development. Some of these effects may be minimised through appropriate siting, design and landscaping schemes, depending on the

size and type of development proposed. To assist assessment by the Department proposals should be accompanied by objective descriptive material and analysis wherever possible even though the final decision on the visual and landscape effects will be, to some extent, one made by professional judgement. Advice on proposals for wind energy development is set out in Annex 1.

- 4.18. Of all renewable technologies, wind turbines are likely to have the greatest visual and landscape effects. However, in assessing planning applications, the Department recognises that the impact of turbines on the landscape will vary according to the size and number of turbines and the type of landscape involved, and that some of these impacts may be temporary if conditions are attached to planning permissions which require the future decommissioning of turbines.
- 4.19. The Department's Environment and Heritage Service has commissioned a study of all 130 Landscape Character Areas identified within the Northern Ireland Landscape Character Assessment 2000 having specific regard to potential wind energy developments. This study will assess the capacity of the landscape, including Areas of Outstanding Natural Beauty, to accommodate such development and will identify those characteristics that may be sensitive to wind energy development. Within such broad Landscape Character Areas there will inevitably be areas of varying sensitivity with different implications for development.
- 4.20. When this study is completed, the Department will expect landscape assessments of wind energy developments to be informed by this analysis.

*Community Involvement and Benefits*

- 4.21. The Department considers that developers of renewable energy projects, in particular windfarms, should take an active role in engaging with the local community. This should include pre-application discussion and provision of background information on the renewable energy technology that is proposed.
- 4.22. Experience has shown that there are opportunities to achieve community benefits through large-scale renewable energy projects such as major windfarm development. Certain benefits can be justified as mitigation of development impacts through the planning process. In addition, developers may offer other community benefits not directly related to the planning process. Annex 3 provides further information and examples about the types of community benefit which have been provided through windfarm developments in Great Britain. The Department would encourage such proposals. Groups such as Action Renewables, the Energy Savings Trust or the Carbon Trust can support and advise on community involvement in developing renewable energy and benefitting from it. The Department would stress however that the offer of community benefits from a developer will not enable

permission to be given to a proposal that otherwise would be unacceptable in planning terms.

### *Decommissioning*

- 4.23. In relation to wind energy developments which become redundant, the Department will seek to ensure that the site will be restored to a condition which is as close as possible to its original state as appropriate to its location, and the works necessary to secure the restoration.

### *Information Requirements*

- 4.24. Certain renewable energy developments, depending on their scale or location, may require a formal Environmental Impact Assessment (EIA) under the provisions of the Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999. Further information on the need for EIA for the various renewable energy technologies is set out in Annex 1. In addition, where such development is located in a “sensitive area”<sup>4</sup>, EIA will also be required if it is likely to have a significant effect on the environment. Development Control Advice Note 10 Environmental Impact Assessment provides general guidance for prospective developers on this matter and highlights requirements in relation to procedures to be followed where projects in Northern Ireland are likely to have a significant effect on the Republic of Ireland.
- 4.25. Where renewable energy development does not fall within the requirements of the EIA Regulations, the Department will still expect an assessment of the environmental effects of the development to be submitted with any application. The level of detail required should reflect the scale of the technology employed and take account of its location. For most micro-generation schemes a short report will normally suffice. For larger scale projects, developers will also be expected to outline the benefits arising from the development in terms of the energy produced in order to enable a balanced assessment of the proposal to be carried out.
- 4.26. The Department would also draw the attention of prospective developers of renewable energy projects to the Conservation (Natural Habitats, etc) Regulations (Northern Ireland) 1995. Under these Regulations the Department, as the “competent authority”, is required to undertake an Appropriate Assessment of any proposal that has the potential to significantly effect a European Site, either directly or indirectly. In such cases developers must provide such information as the Department may reasonably require for the purposes of this

---

<sup>4</sup> Regulation 3 of the Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999 defines a sensitive area as: an Area of Special Scientific Interest (ASSI); an Area of Outstanding Natural Beauty (AONB); a National Park; a World Heritage Site; a scheduled Monument; or European Sites as defined in regulation 9 of the Conservation (Natural Habitats, etc.) Regulations (Northern Ireland) 1995 such as a Special Protection Area (SPA) or a Special Area of Conservation (SAC).

Assessment. Further information on Appropriate Assessment is contained in the publication: Habitats Regulations Guidance Notes for Competent Authorities, Environment and Heritage Service September 2002. It should be noted that under the provisions of Planning Policy Statement 2, that Appropriate Assessment may be required for renewable energy proposals that have the potential to significantly effect other Sites of International Nature Conservation Importance (reference footnote 3 page 16).

- 4.27. The Department would stress that failure to supply adequate environmental information to accompany planning applications for renewable energy projects, in particular large scale schemes such as windfarms, is a key cause of delay in determining such proposals.

## **Policy RE 2**

### **Integrated Renewable Energy and Passive Solar Design**

**Planning permission will be granted for a development proposal involving the integration of renewable energy technology, including micro-generation, where it meets the provisions of Policy RE1 and provided the technology is appropriate to the location in question in terms of any visual or amenity impact it may have.**

**The Department wishes to encourage greater application of the principles of Passive Solar Design (PSD) through the planning system, while recognising this is likely to be constrained to an extent by building and location specific factors.**

**To assist this process, applicants for the following types of development will be expected to demonstrate what consideration has been given to PSD principles in the layout, siting and design of their proposals:**

- **all public sector development;**
- **large-scale urban development (generally defined for the purposes of this policy as a site of 1ha or greater or a building of 5,000m<sup>2</sup> or greater); and**
- **dwelling in the countryside.**

**For other forms of development the Department will also encourage the application of PSD principles.**

**The information and best practice guidance on Passive Solar Design set out in Annex 2 will be taken into account in assessing proposals.**

### **Justification and amplification**

- 4.28. As part of its overall efforts to promote renewable energy and carbon efficiency, the Government wishes to facilitate and encourage greater integration of renewable energy technologies, both in the design of new buildings and through the appropriate retrofitting of such technologies to existing buildings. For many buildings this will mean increased consideration of the benefits of small-scale renewable energy technologies (often referred to as 'micro-generation'). In addition it will entail greater consideration of complementary measures in the design of new buildings, such as the application of Passive Solar Design principles, to help achieve energy gains.

### *Micro-generation*

- 4.29. Micro-generation is widely accepted to be the production of heat (less than 45 kW capacity) and/or electricity (less than 50kW capacity) from low or zero carbon energy sources. In addition to the carbon benefits, increased use of micro-renewables plays an important part in diversifying our energy mix and ensuring security of energy supply. It can allow energy to be produced and consumed locally, help alleviate fuel poverty (especially in off-gas network areas) and play a part in meeting renewable energy targets.
- 4.30. Some forms of micro-generation development currently benefit from permitted development rights under the Planning (General Development) Order (Northern Ireland) 1993 and therefore do not require an application for planning permission. These existing permitted development rights mostly date back to before the 1990s and were not designed to facilitate micro-generation development.
- 4.31. The Department recently consulted on a review of existing householder permitted development rights and overall is seeking to provide a simplified regulatory regime for micro-generation development that will facilitate such development<sup>5</sup>. Following the outcome of this review, further amplification will be provided to this policy.
- 4.32. In the meantime, Planning Service Information Leaflet 12 published in August 2006 provides guidance to householders on the extent to which small scale renewable energy development could currently be 'permitted development'.
- 4.33. The Department will encourage developers to consider the opportunity for incorporating renewable energy projects in all new developments. Small scale renewable energy schemes utilising technologies such as solar panels, Biomass heating, small scale wind turbines, photovoltaic cells and combined heat and power schemes can be incorporated both into new developments and some existing buildings.

### *Building Regulations*

- 4.34. As part of a Government drive to promote greater uptake of renewable energy technologies, the Department of Finance and Personnel is currently considering changes to the Building Regulations that will require the incorporation of low or zero carbon energy sources in all new development. Should these changes come into effect, they will apply to all new homes, company and public buildings and provide a predicted annual reduction in CO<sub>2</sub> emissions.

---

<sup>5</sup> Further information about the consultation on householder Permitted Development rights for small-scale renewable energy (micro-generation) can be found on the Planning Service website: [www.planningni.gov.uk](http://www.planningni.gov.uk)

- 4.35. Low or zero carbon energy sources will mean any of the following systems for the production of electricity and/or heat – biomass heating (excluding an open fire), combined heat and power, fuel cell, geothermal, heat pump, hydro, photovoltaic, solar hot water, waste heat (excluding ventilation heat recovery) or wind power.

### *Passive Solar Design*

- 4.36. Passive Solar Design (PSD) refers to the use of solar energy for the heating and cooling of buildings. Using this approach, the building itself or some part of it will take advantage of the natural energy in materials and air created by exposure to the sun. PSD needs to be considered at the design stage as it provides effectively a one-off opportunity to save energy during the lifetime of a building, generally at no cost. In modern housing up to 20–25% of heating and lighting energy can be saved by the application of PSD principles.
- 4.37. Optimising use of natural heat and light through PSD can displace energy which would otherwise have been generated from fossil fuel sources. Solar heated air and wind can also be used in natural ventilation or cooling systems. Planning decisions on site selection, road access arrangements, building orientation and spacing and landscape design can all influence the ability of new development to employ PSD techniques effectively. PSD can be used in conjunction with other efficiency measures including increasing insulation, double glazing, draught proofing, use of energy efficient appliances and fittings, efficient heating controls and condensing boilers.
- 4.38. The key to realising the benefits of PSD is one of scale. Individual exemplars will not make a substantial difference to CO<sub>2</sub> reduction targets, but if a significant proportion of new public sector buildings, housing and office developments adopted the principles then worthwhile environmental benefits would be achieved.
- 4.39. The Department considers that Planning Control has an important role to play in encouraging the greater application of the principles of PSD, particularly amongst house builders, and in the design of public and commercial buildings.
- 4.40. This PPS specifically includes “passive solar” as a complementary measure to renewable energy technologies that should be taken into account in the assessment of development proposals.
- 4.41. Applying PSD principles will be particularly important at the master plan stage of major developments. Those responsible for preparing design concept statements and master plans should therefore consider PSD requirements alongside routine matters such as access and infrastructure. Equally it is considered that PSD principles can bring important benefits to the design of new dwellings in the countryside.

- 4.42. In assessing proposals account will be taken of the information and best practice guidance set out in Annex 2. Attention is also drawn to the Energy Savings Trust publication (GIR27) Passive Solar Estate Layout –General Information Report 27 (1997). This document can be accessed through the Energy Saving Trust’s website:  
[www.energysavingtrust.org.uk](http://www.energysavingtrust.org.uk).
- 4.43. Applicants for those forms of development indicated in this policy will be required to demonstrate what consideration has been given to PSD in the design of their proposals. This will entail submission of a written report addressing this matter normally by a person competent to do so, for example an architect, building surveyor or energy consultant. The amount of information required will clearly vary according to the complexity of the scheme in question.
- 4.44. It should be noted that because PSD concerns the fundamental design of a building it cannot easily be dealt with by way of planning conditions.



# ANNEX 1 - Information and best practice guidance for renewable energy development proposals

This annex provides background information on the various renewable energy technologies that may come forward in Northern Ireland and is designed to contribute to the development control process. It has been drawn up taking account of similar material available for other parts of the UK and the Republic of Ireland. This includes:

- Scottish Executive Planning Advice Note 45, Renewable Energy Technologies (2002);
- the technical annex to the Companion Guide to Planning Policy Statement 22 issued by the Office of the Deputy Prime Minister (2004);
- Planning Policy Wales, Technical Advice Note 8: Planning for Renewable Energy (2005); and
- Wind Energy Development Guidelines, Department of the Environment, Heritage and Local Government (Ireland) (2006).

The advice and guidance contained within this annex should be read in conjunction with Policy RE1 Renewable Energy Development.

## A. Wind energy

### INTRODUCTION

A1. This section describes the technology of wind turbines in relation to current turbine sizes (600kW-3MW) that are expected to comprise the bulk of the UK's onshore wind generated electricity provision. In most respects this information will be equally valid for both smaller wind turbines, more suited to locations with higher population densities, and the larger machines that will be developed in the coming years. Where there are differences these will be clearly noted. The section discusses only land-based turbines, although there is essentially little difference between these and machines that are installed off-shore.


A2. A typical wind energy development may include the following elements:

Wind turbines	
Wind monitoring mast	
Transformers	Serving each turbine.
Internal tracks and crane pads	Giving access to the turbines.
Substation compound	Including transformers, circuit breakers and control building.
Power cables	Usually underground within the site.
Poles/pylons	Connecting wind energy development site to the national grid

## TECHNOLOGY

- A3. There are essentially two types of wind turbine – those that have rotors that rotate about a vertical axis, and horizontal axis machines whose rotating shafts are aligned horizontally. Most wind turbines installed today are of the latter type and this is likely to remain the case for the foreseeable future. The remainder of this section refers primarily to horizontal axis machines.
- A4. Whilst wind turbines are sometimes used to generate mechanical power, particularly for pumping water, this section deals only with the electricity producing variety. Such wind turbines convert the kinetic energy of the wind that passes through the swept area of the rotor into electrical energy by means of a rotor (generally comprising 3 blades), a mechanical drive train (usually including a gearbox) and an electrical generator. These are all mounted on a tower. The height of the tower is normally at least twice the length of a blade. The blades need to be far enough from the ground to minimise turbulence and to maximise the energy capture of the wind turbine. Normally solid tubular towers are used rather than lattice constructed towers.
- A5. Wind turbines are defined by the size (diameter) of the rotor and rated power or capacity in kilowatts (kW) or megawatts (MW). The rated capacity of a wind turbine is a measure of the maximum output of the electricity generator which will generally be achieved in wind speeds greater than 12-15m/s at the hub height of the rotor. There are two things worth noting:
- an increase in the rotor diameter of a wind turbine will result in a greater than proportional change in rated power (see figure 1);
  - an increase in wind speed will result in a greater than proportional change in rated power. Rated power is proportional to the cube of the wind speed, and hence a doubling of wind speed will result in a roughly eight-fold increase in power output.
- A6. Technological advances have led to a wide range of wind turbine designs. The smallest turbines, some with a rotor diameter of less than one metre, are usually used for charging batteries although recent mains-connected micro-turbines have been introduced to the market. At the other end of the scale turbines with rotor diameters of greater than 100m are now being deployed.

**Figure 1**  
**Approximate sizes of typical three-bladed turbines by installed capacity, also showing approximate annual energy output based on an average capacity factor of 0.3, the figure for the number of homes supplied is based on the average UK household consumption of 4100 kWh/year (OFGEM)**

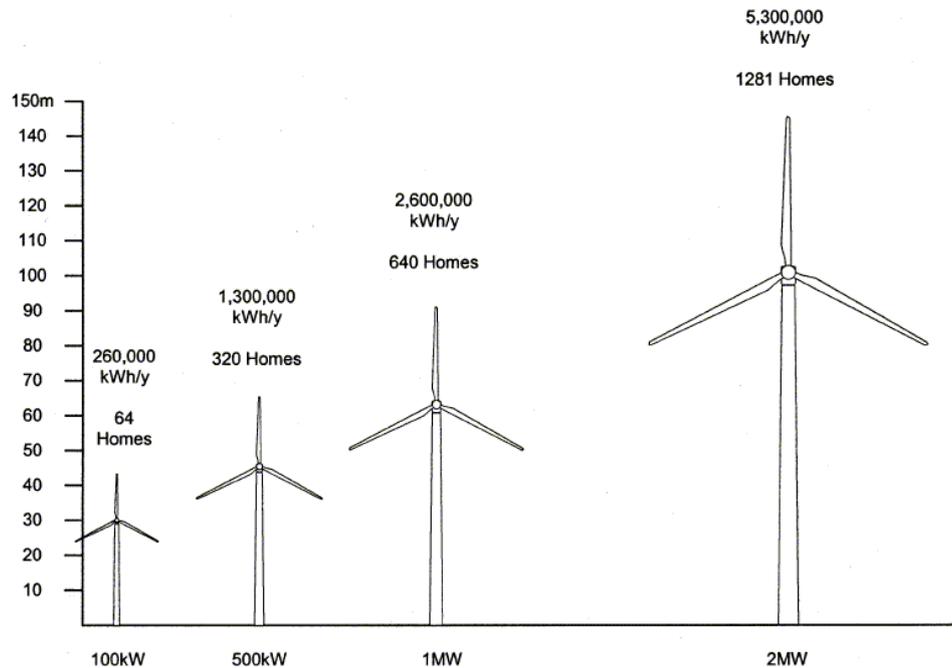

- A7. The blades are usually of a glass-fibre reinforced plastic construction. Other materials used include wood-epoxy laminates and carbon fibres. These may both become more prevalent as current wind turbine designs are scaled up. They are generally the largest single item that is transported to a wind farm during construction. Smaller turbines (less than 50kW) may use blades made of a variety of other materials such as plastics, metal or wood.
- A8. The blades are attached to the hub, which is in turn attached to the main shaft that drives the generator, usually but not always via a gearbox.
- A9. The generator, gearbox and yaw drive that turns the rotor to face the wind are the main components housed within the nacelle. For large, grid-connected turbines the rotor alignment with the oncoming wind is always controlled actively via the yaw drive and they are designed so that the blades see the wind before the tower does. Such a design is known as an upwind rotor with active yaw control. Smaller turbine designs may use upwind or downwind rotors and may use active or passive yaw control. Vertical axis machines require no yaw control by virtue of their design.
- A10. The nacelle is mounted on the tower, which for large grid-connected turbines is normally of a tubular steel construction. Smaller turbines

(less than 50kW) may be mounted on similarly designed towers, but may equally use lattice or guyed towers. Turbines designed specifically for micro-generation may be mounted directly onto existing structures, such as roofs.

**Figure 2**  
**Main components of a wind turbine**

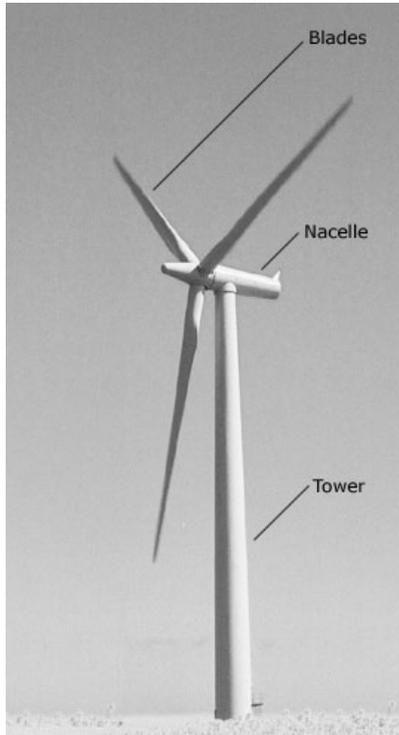


ILLUSTRATION: BWEA

- A11. There are a number of technical differences amongst the wind turbines that are currently available. The most obvious difference is in the number of blades. Most machines now have three blades, but there are some two-bladed machines in operation. Other than this the two most important differences are the way in which a turbine regulates its power capture above rated wind speed (pitch or stall regulation) and whether the machine operates at a fixed or variable rotor speed.
- A12. The turbine is controlled by its own computer system, which provides both operational and safety functions. In addition to controlling blade angle and rotor speed, a wind turbine's control system must also align the rotor with the oncoming wind. This is achieved by rotating the nacelle in relation to the tower top with a yaw gear mechanism.
- A13. Modern wind turbines also continuously monitor their own performance and if atypical vibrations caused by component imbalances are detected, or if connection to the local electricity grid infrastructure is lost, all turbines must be capable of emergency stops. Most modern wind turbines undergo test certification procedures, which must


conform to the guidelines laid down by the International Electro-technical Commission (IEC).

- A14. Wind turbines can be deployed singly, in small clusters, or in larger groups known as wind farms. Factors that may influence the size of a development include the physical nature of the site, the capacity of the local electricity distribution network and the organisation undertaking the development. It is likely that the Region's wind resource will be harnessed most satisfactorily using a mixture of these types of development.
- A15. The direction of rotation of the wind turbine rotors will be common across a wind farm. Wind turbines are usually semi-matt white, off white or grey in colour, often as a condition of planning permission. The colours of the blades, nacelle and towers are normally the same.

### Spacing of Turbines

- A16. Wind turbines need to be positioned so that the distances between them are between 3-10 rotor diameters (about 180-600 metres for a wind farm using 60m diameter, 1.3MW wind turbines) depending on the individual circumstances of the site. This spacing represents a compromise between compactness, which minimises capital cost, and the need for adequate separations to lessen energy loss through wind shadowing from upstream machines. The required spacing will often be dependent on the prevailing wind direction as illustrated in Figure 3 below, which shows a possible layout for a site in Northern Ireland with a typical South Westerly prevailing wind direction.

**Figure 3**  
Example turbine spacing in a wind farm with a South Westerly prevailing wind direction

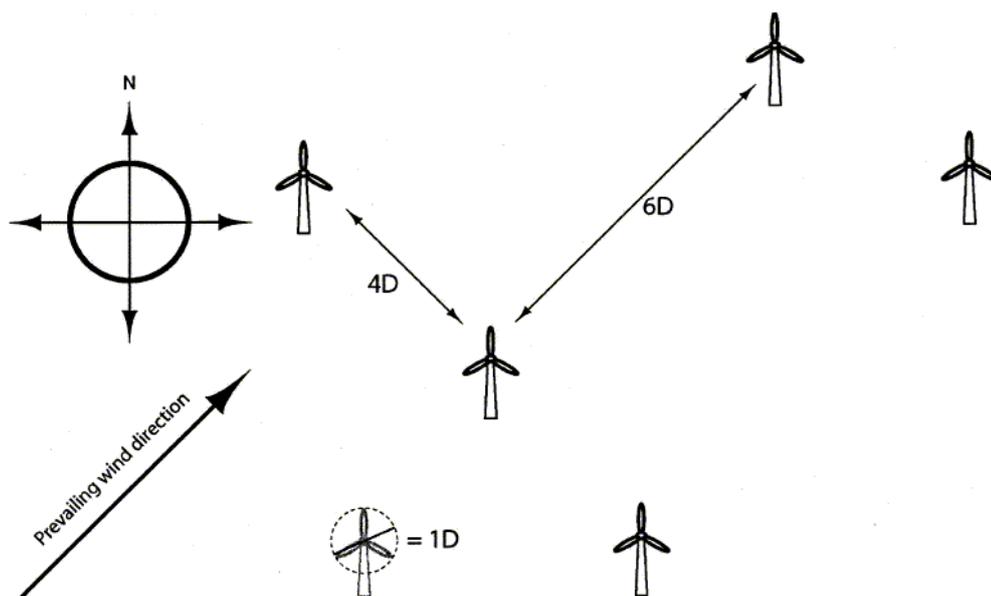

- A17. Bearing in mind the requirements for optimal performance, a distance of not less than two rotor diameters from adjoining property boundaries will generally be expected, unless there is written agreement of adjoining landowners to a lesser distance.

### **Other Infrastructure**

- A18. In addition to wind turbines, the required infrastructure of a wind farm consists of adequate road access, on site-tracks, turbine foundations, crane hard standings, one or more anemometer masts, a construction compound, electrical cabling and an electrical sub-station and control building. Some of these features are permanent and others are required only in the construction phase and as such are temporary.
- A19. One or more anemometer masts may be required on-site. These are usually slender structures with guy supports, built to the hub height of the turbines, with anemometers and wind vanes mounted at different heights. Anemometer masts are needed as part of the project planning and design process but they are also needed post-construction in order to provide control information.
- A20. A construction compound will generally be specified in the proposal. While this is of a temporary nature, its location should be identified with the planning application.
- A21. The road access to a wind farm site will need to be able to accommodate trailers carrying the longest loads (usually the blades), as well as the heaviest and widest loads (generally the cranes required in erection). Amendments to existing roads required to gain access to site should be detailed in any wind farm planning application.
- A22. On-site tracks need to meet the weight and dimensional requirements detailed above. A developer may propose that they are left in this condition for the life of the wind farm or may ask to retain them in a reduced state (by, for instance, narrowing the roads and reinstating the verges). In either case there will be an operational requirement for decommissioning and to gain access to the site for routine maintenance with light vehicles, as well as to reach the site with loads potentially as large as those initially used. This would only be required in the case of a major component failure.
- A23. Larger hard standings are also required next to each turbine to act as bases for cranes during turbine erection and component lay down areas. These hard standing should be constructed and finished in an appropriate material to allow for habitat regeneration.
- A24. The towers of the turbines are fixed to a concrete foundation whose surface will normally be flush with the surrounding ground. This foundation pad is likely to be square or hexagonal in shape and about 7-20 metres across. The diameter of the base of the turbine tower is

likely to be 2-5 metres. The land area actually used by the turbines is therefore very small. On land where public access is allowed, people might walk right up to the base of the towers without interfering with turbine operation. On land normally used for agricultural purposes, agricultural use could continue right up to the edge of the foundations.

### **Connection to the Electricity Grid**

- A25. A wind farm is likely to be connected to the electricity distribution network just like any other power station. Small transformers are required to change the generating voltage (likely to be 690V) to a common site voltage which is likely to be 11kV, 33kV or 110 kV. These transformers can either be housed outside or within the turbine tower. The output from the turbines in a wind farm is normally connected to a single point via underground cables.
- A26. Responsibility for the routing of electrical cabling onwards from the sub-station to the nearest suitable point of the local electricity distribution network is the responsibility of the District Network Operator, presently NIE. This will be achieved either by a standard 3-wire system mounted on wooden poles or by lines laid underground. It should be noted, however, that laying high voltage cables underground is much more expensive (around 6-20 times greater) than pole-mounted overhead systems and would be likely to be used only for limited lengths and/or in special circumstances. Whilst the routing of such lines by NIE is usually dealt with separate to the planning application for the wind farm, developers will generally be expected to provide details of likely routes and the method of connection (overground or underground).

### **Operation and Maintenance**

- A27. A wind farm is often equipped with a central monitoring system. This consists of a computer that supervises the operation of the farm and can communicate with a remote headquarters. Wind farms are likely to be un-manned, and their operational status regularly checked through the central monitoring system and remote link. Such a checking system may be housed in a small building somewhere on a wind farm site or may quite normally be combined with the sub-station. Remote links will require associated equipment in order to allow communication to take place, for example an aerial or dish.

### **Wind Resource**

- A28. The energy produced by a wind turbine depends on the strength of the wind to which it is exposed. The simplest indicator of the wind resource available at a given location is the annual mean wind speed at the site (usually given at the hub height of the turbine). A machine located on a site which has an annual mean wind speed of 6 metres per second will

typically produce only half as much energy as the same machine on a site where the annual wind speed is 8 metres per second.

- A29. For any given location the wind speed rises with elevation above the ground due to wind shear. The degree of wind shear (the rate at which the wind speed increases when moving vertically away from the ground) is dependent on the surrounding ground conditions; the higher the surrounding obstructions (e.g. vegetation or buildings) the greater the wind shear produced. Due to this, raising the hub height of the turbines, by mounting them on taller towers, can increase the energy capture at any given site. Current hub heights available to developers are between 50-100m.
- A30. As well as affecting the wind shear, surrounding obstacles such as woodlands and buildings will increase the turbulence in the wind. Higher turbulence levels in the wind adversely affect wind turbine performance and life expectancy and, as such, developers will look to position turbines as far away from obstacles as is practicable. Again, the use of taller towers can ameliorate this effect by placing the rotor in less disturbed air.
- A31. Assessing whether a particular site will harness wind power satisfactorily entails using historical meteorological data (available from the Meteorological Office) and information derived from anemometers placed on site. Anemometer masts are normally required on a site for at least 12 months; the longer measurements are taken the better the predictions will be. The measurements from the anemometers help to determine whether or not a candidate site is suitable and, if it is, the measurements help to determine the best position for the wind turbines within the site's boundary. The masts should be approximately as tall as the hub height of the planned turbine. However, often when the mast is erected it is not known either if the site is suitable for wind farming or which turbine type would be most suitable. Masts are usually 25-60m tall. Planning permission is required to erect a temporary anemometer mast.
- A32. The mean wind speed at hub height (along with the statistical distribution of predicted wind speeds about this mean and the wind turbines used) will determine the energy captured at a site. The simplest way of expressing the energy capture at a site is by use of the Capacity Factor.
- A33. This can be expressed alternatively as the actual energy generated by a wind turbine over the course of 1 year divided by the energy that would have been generated by a wind turbine over the course of 1 year had the wind been consistently blowing at speeds between rated and cut-out (typically 12-25m/s). Capacity factors in the UK may generally fall anywhere between 0.2 and 0.5, with 0.3 being typical in the UK.

## PLANNING ISSUES

### General

- A34. All development involving wind turbines currently requires planning permission under the Planning (Northern Ireland) (Order) 1991. The Department has recently consulted about new permitted development rights for small scale renewable energy development associated with dwelling houses. However, domestic wind turbines typically have an output of only up to 2.5kW.
- A35. The successful development of wind energy always entails detailed consideration of a wide range of factors and the developer may need to provide information on some if not all of the following matters:
- Overall economic and social benefits attributed to the scheme;
  - Potential impact of the project on nature conservation, to include direct and indirect effects on protected sites, on habitats and species of ecological sensitivity and biodiversity value and, where necessary, management plans to deal with the satisfactory co-existence of the wind energy development and the particular species/habitat identified;
  - Potential impact of the project on the built heritage including archaeology;
  - Ground conditions, including peat stability;
  - Site drainage, sedimentation and hydrological effects, such as water supply and quality and watercourse crossings;
  - Size, scale and layout and the degree to which the wind energy project is visible over certain areas;
  - Landscape character and visual impact issues including ancillary development, such as access roads;
  - Local environmental impacts including noise, shadow flicker, electromagnetic interference, etc;
  - Adequacy of local access road network to facilitate construction of the project and transportation of large machinery and turbine parts to site;
  - Information on any cumulative effects due to other projects, including effects on natural heritage and visual effects;
  - Information on the location of quarries to be used or borrow pits proposed during the construction phase and associated remedial works thereafter;
  - Temporary and/or permanent storage, disposal or elimination of waste/surplus material from construction/site clearance, particularly significant for peatland sites; and
  - Decommissioning considerations.
- A36. Although in the past most windfarm development tended to be located in upland areas due to higher wind speeds, technological advances, and changes to the renewable electricity markets have resulted in wind speed being less pivotal in the site selection process. Generally, whether there is a reasonable prospect of obtaining planning

permission is becoming a much more dominant factor in the initial site selection process.

- A37. The planning system exists to regulate the development and use of land in the public interest. The material question is whether the proposal would have an unacceptable detrimental effect on the locality generally, and on amenities that ought, in the public interest, to be protected. Each planning application will be considered on its own merits, and the argument that granting permission might lead to another application will not be sufficient grounds for refusal.

### **Specific Issues**

- A38. There are a number of issues specific to wind turbine developments that need to be considered when determining an application for planning permission. Where Environmental Impact Assessment (EIA) is deemed necessary (see paragraph A117) the potential issues should be covered in the Environmental Statement but, for smaller developments that do not require a full EIA, the Department will often still require some or all of the issues to be addressed through an environmental report to accompany the planning application.

### **Nature Conservation**

- A39. Planning Policy Statement 2 Planning and Nature Conservation<sup>6</sup> sets out the Department's current planning policies on nature conservation that are taken into account when considering any development of land. As the development of a wind farm is a civil engineering project, there can be potentially serious implications for biodiversity. The major ecological impacts are most likely to be associated with site infrastructure rather than the turbines themselves – other than the impact of the moving blades upon birds and bats, and the advice contained in PPS 2 should cover all aspects of the development. With such extensive application sites there will very often be opportunities for developers to mitigate for any potential ecological damage and preferably enhance current wildlife habitats.
- A40. Beyond designated sites and peatland habitats the impact of a wind farm on local nature conservation interests should be minimal. A typical wind farm will usually leave the land between the turbines totally unaffected. There is little evidence that domesticated or wild animals will be affected by a wind farm – indeed, there are examples of cows and sheep grazing right up to the base of turbines.
- A41. Applications to harness wind energy may be made in Sites of International Nature Conservation Importance, and such applications will be subject to the most rigorous examination. Developers should also note that applications which have the potential to significantly

---

<sup>6</sup> This Planning Policy Statement is currently under review

effect any such site as a matter of policy will be subject to an Appropriate Assessment<sup>7</sup>.

- A42. Experience indicates that bird species and their habitats are rarely affected by wind turbine developments and the impact of an appropriately designed and located wind farm on the local bird life should, in many cases, be minimal. To date, the most common concern has been the risk of 'bird strike' i.e. birds flying through the area swept by the blades and being hit, causing injury or death. This is most likely to occur if a wind turbine is erected directly in a migration path, where there are high concentrations of particular species (i.e. birds feeding), or where there are vulnerable species. Most birds in flight can be expected to take action to avoid obstacles but different species will vary in their reaction and manoeuvrability. Most evidence to date suggests that the risk of collision is minimal. However, some areas are important for a variety of bird species protected under the EU and UK legislation (SPAs, SACs and ASSIs). These could represent potential constraints to wind farm development. As indicated in PPS 2 on nature conservation, the importance of complying with international and national conservation obligations must be recognised and wind farms should not adversely affect the integrity of designated sites. Protected species, such as hen harriers, occupy many areas outside designated sites and are protected across Northern Ireland. These factors have to be considered against the positioning and size of turbines, including the size of the area swept by the blades in relation to the air space used by the birds in the vicinity of the development.
- A43. Early consultation between the developer and the Department's Environment and Heritage Service (EHS) and RSPB is recommended. Most sites will require an assessment of breeding birds (between late March and early June) and wintering birds (November to February). Others, where potential ornithological sensitivities are higher, may require substantially more survey work, including studies of wintering/passage birds, raptors and moorland birds and detailed observations to quantify bird flight activity across the site.
- A44. Among the other potential impacts to birds, loss of habitat, the deposition of spoil or hazardous substances from construction and operation, scrub and hedgerow removal should also be assessed.

---

<sup>7</sup> Regulation 43, Conservation (Natural Habitats, etc) Regulations (Northern Ireland) 1995

“The risks of disturbance to bird species during construction and operation of the wind farm is also an important consideration. For some species this is of greater potential significance than collision mortality. Scottish Natural Heritage, in consultation with the British Wind Energy Association (BWEA), is preparing a ‘Methodology for assessing the effect of wind farms on ornithological interests’. Whilst this publication tackles the situation in Scotland it is equally relevant to England. In addition, the DTI’s Renewable Energy Programme has published a report ‘Cumulative effects of wind turbines’ in which Section 3 deals with ‘Cumulative effects on birds’. Both will be of use to developers when assessing the potential impact of proposed developments on bird life. Royal Society for the Protection of Birds (RSPB), World Wildlife Fund (WWF), English Nature and BWEA have also published ‘Wind Farm Development and Nature Conservation’. Another useful source of information is ‘Windfarms and Birds: An analysis of the effects of wind farms on birds, and guidance on environmental assessment criteria and site selection issues.’”

*RHW Langston & JD Pullan (2003). BirdLife International on behalf of the Berne Convention.*

- A45. The impact of the moving blades of a wind turbine upon bats and their ultrasound has also on occasion been raised as a concern, but there is little evidence to date to suggest that significant numbers of deaths or injuries will occur. Early consultation between the developer and EHS and the Bat Conservation Trust is recommended. Some sites may require the submission of a bat survey to assess the use of the site.
- A46. In addition, under the EC Habitats Directive, other species or habitats of special interest may be present. For example, active peatland is of particular importance to the Region for its biodiversity, water and carbon storage and can be adversely affected by wind farm development. In general such areas should be avoided and where possible, encourage the restoration of degraded areas.
- A47. The main potential impacts on habitats that can result in the reduction, or loss, of biodiversity are:
- Direct loss of habitat to the developments’ infrastructure, including turbine foundations, crane pads, buildings, roads, quarries and borrow pits;
  - Degradation of habitats through alteration or disturbance, in particular arising from changes to hydrology that may alter the surface or groundwater flows and levels, and drainage patterns critical in peatlands and river headwaters and increase the risk of bog burst;
  - Fragmentation of habitats and increased edge effects;
  - Changes to land management brought about by improved access; and

- Degradation and loss of habitats outside the development site, especially wetland habitats that may arise from pollution, siltation and erosion originating from within the development site.

A48. Developers should ensure that their ecological advisers enter into early discussions with EHS about the presence and importance of species and habitats in and around a proposed development site. Discussions should assess any potential impacts and the scope for mitigation in the design and layout. A Phase1 Habitat Survey could usefully inform these discussions. In addition discussions with locally based groups such as the Ulster Wildlife Trust or RSPB could benefit the ecological assessment procedure.

### **Landscape and Visual Impact**

A49. In order to minimise wind speed variations, commercial wind energy developments need to be located in areas of relatively smooth and rounded relief. They also require ready access to the electricity transmission and distribution system unless they are intended solely for private use. The current generation of turbines is capable of operating at lower wind speeds than previously due to the marketing regime and wind turbine size increases, which has the effect of increasing the types of areas (and landscapes) that may attract developer interest. Public concern over the visual impact of past (and many current proposals) has been a recurring feature. Experience, following construction, suggests that much of the fear is unnecessary. It is, nevertheless, an issue that continues to need to be addressed.

A50. There are a number of publications that can assist planners, developers and other professionals in addressing landscape issues. These include the Landscape Institute publication Guidelines for Landscape and Visual Impact Assessment 2<sup>nd</sup> edition, 2002 (currently under review); Scottish Natural Heritage (2001) Guidelines on the Environmental Impacts of Windfarms and Small Scale Hydroelectric Schemes; and Scottish Natural Heritage (2005) Guidance: Cumulative Effect of Windfarms, Version 2.

A51. Northern Ireland has a variety of landscapes as identified in the Northern Ireland Landscape Character Assessment, 2000. Some will be able to accommodate wind farms more easily than others, on account of their landform and relief and ability to limit visibility. Some are highly valued for their quality. There are no landscapes into which a wind farm will not introduce a new and distinctive feature. Given the Government's commitment to addressing the important issue of climate change and the contribution expected from renewable energy developments, particularly wind farms, it is important for society at large to accept them as a feature of many areas of the Region for the foreseeable future.

A52. This is not to suggest that areas valued for their particular landscape and/or nature conservation interest will have to be sacrificed. Nor that elsewhere, attempts to lessen the impacts by integrating the development into the surrounding landscape would not be worthwhile. On the contrary, it emphasises the need for account to be taken of regional and local landscape considerations. Careful consideration is required to locate the development and even though highly visible, every effort should be made to reduce the impact and aid integration into the local landscape.

A53. The landscape and visual impact of wind turbines is influenced by:

- land form;
- landscape character and features;
- number, size and layout of turbines, and their inter-relationship;
- how the turbines relate to the skyline
- design and colour;
- visual receptors;
- access tracks; and
- ancillary components like power lines and substations.

In addition it is acknowledged that the construction and transportation of turbines will have an impact on the local landscape.

A54. The capacity of the landscape to accommodate wind farm development depends on three considerations:

- the degree of impact the development will have on the existing character of the landscape;
- the sensitivity of the character of the landscape; and
- the extent to which this impact can be modified and reduced by design.

However it will not necessarily be the case that the extent of visual impact or visibility of wind farm development will give rise to negative effects; wind farm developments are by their nature highly visible yet this in itself should not preclude them as acceptable features in the landscape.

A55. The ability of the landscape to absorb development depends on careful siting, the skill of the designer, and the inherent characteristics of the landscape such as landform, ridges, hills, valleys, and vegetation.

A56. A cautious approach is necessary in relation to those landscapes which are of designated significant value, such as both existing and proposed Areas of Outstanding Natural Beauty, the Giant's Causeway World Heritage Site and the proposed Mourne National Park and their wider settings. Here, it may be difficult to accommodate wind turbines without detriment to the Region's cultural and natural heritage interests.

A57. Specific to the Northern Ireland context, the Department's Environment and Heritage Service has commissioned a study of the 130 Landscape Character Areas (LCAs) identified in the Northern Ireland Landscape

Character Assessment, having specific regard to potential wind energy developments. This study will focus on the sensitivity of the LCAs to wind energy developments and will identify landscape characteristics that may be sensitive to wind farm development and will also consider the landscape and visual analysis process. Within such broad areas there will be areas of varying sensitivity with different implications for development.

*Visual Impact*

A58. Turbines in wind farms will normally be tall (up to 100m+), frequently located in open land, and therefore will often be highly visible. Domestic turbines will be smaller (generally less than 15m). It will normally be unrealistic to seek to conceal them. Developers should seek to ensure that through good siting and design, landscape and visual impacts are limited and appropriate to the location. The visual impact will be dependent on the distance over which a wind farm may be viewed, whether the turbines can be viewed adjacent to other features, different weather conditions, the scale and layout of the development and the landscape and nature of the visibility. The following is a general guide to the effect which distance has on the perception of the development in an open landscape.

**General Perception of a Wind Farm in an Open Landscape:**

Up to 2kms	Likely to be a prominent feature
2-5kms	Relatively prominent
5-15kms	Prominent in clear visibility - seen as part of the wider landscape
15-30kms	Only seen in very clear visibility - a minor element in the landscape.

A59. The visual impact of wind farms will be affected by their siting and layout in relation to local land form and landscape characteristics, and the qualities of the specific site, as well as by the number and arrangement of turbines. Different layouts will be appropriate in different circumstances. For example, grouped turbines can normally appear acceptable as a single, isolated feature in an open, undeveloped landscape, while rows of turbines may be more appropriate in a flatter agricultural landscape with formal field boundaries. Although wind farms may be complex, they should not appear confusing in relation to the character of the landscape. Ideally they should be separate from surrounding features to create a simple image. The design of each development must be appropriate to its site. The study commissioned by EHS (ref. paragraph A57) will consider this matter in more detail.

A60. The style and colour of turbines can also be relevant. Experience suggests that solid towers appear less complex than lattice and tapering towers are generally regarded as being more elegant than cylindrical. In terms of colour, white or off-white is generally preferred,

but other colours may be acceptable in appropriate circumstances. A semi-matt surface is required to reduce the reflection of light. However, colour choice can not be a substitute for good siting and design.

#### *Ancillary development*

- A61. Ancillary elements also need to be fully addressed, as their impact can often be significant. Access tracks should be routed and designed to minimise both visual and habitat impacts. This can be minimised by careful route selection, which takes account of layout and appropriate surfacing material together with the impact of cuttings, embankments and drainage channels. Managing problems of erosion and providing for reinstatement of vegetation along the track is essential. Fencing, buildings and anemometer masts should be located and designed in a way which minimises clutter. It should be noted that peat is very slow at reinstatement and may require active management, e.g. brashings from nearby habitat, to limit the visual impact and erosion potential. The location and extent of the use of any borrow pit should also be indicated in the visual assessment.
- A62. The impact of the transportation of components to site on the minor road network and on the associated trees and hedges should be assessed e.g. transportation involves 40m length lorries requiring large turning circles.
- A63. Power lines connecting the individual turbines to the on-site substation will be underground. To avoid visual confusion, routing and design of power lines, connecting the wind farm substation to the electricity distribution system, will require sensitive treatment.

#### *Visual Assessment*

- A64. There are a number of techniques which may be used to inform visual assessment of a proposed development:
- a **zone of theoretical visibility map** will show where a wind farm may be seen from;
  - **viewpoint analysis** based on key viewpoints throughout the surrounding area;
  - computer generated **wireline diagrams** will indicate how wind turbines will appear from specific viewpoints; and
  - **photo- and video montages** are images whereby an impression of a proposed development is superimposed upon an actual photograph or video of the proposed site.

All of these have strengths and limitations.

- A65. In comparison with other, well-established, forms of development in the countryside, wind turbines are relatively unfamiliar, prominently vertical and have the significant characteristic of movement. Individually or in groups, they will be distinctive features in the landscape. The visual impact of wind turbines must be assessed with these characteristics clearly in mind.

### *Cumulative Landscape and Visual Impacts*

- A66. The cumulative impact of a number of neighbouring developments is an important material consideration. The nature and character of the location, and the landscape in which a development is located, will in part determine the acceptability or otherwise of siting proposals in proximity to each other.
- A67. A number of factors have influenced the current geographic distribution of wind farm proposals in Northern Ireland, for example:
- the distribution of the viable wind resource;
  - technical and economic constraints to the viability of exploiting different wind speeds;
  - electricity grid access constraints;
  - protected areas; and
  - planning policy.
- A68. These have tended to focus developments in a relatively limited number of areas. With increasing numbers of existing and proposed wind energy developments it is necessary to address the cumulative impacts on the landscape with reference to the context that probability of cumulative impacts is increased by existing renewable energy targets and hence greater demand for wind energy developments.
- A69. The cumulative effects of wind farm development can arise as the combined consequences of:
- an existing wind energy development and a proposed extension to that development;
  - proposals for more than one wind energy development within an area;
  - proposal(s) for new wind energy development(s) in an area with one or more existing development(s); and
  - any combination of the above.
- A70. In assessing cumulative effects, it is unreasonable to expect these to extend beyond schemes in the vicinity that have been built, those which have permissions and those that are currently the subject of undetermined applications.

### **Ground Water Conditions/Geology**

- A71. In assessing wind energy developments, the underlying geology is an important factor. Information on the following issues should be submitted as part of a planning application to enable adequate assessment of the impact of the proposed wind energy development and any mitigating measures proposed to counter the impacts:
- A geological assessment of the locality;
  - A geotechnical assessment of the overburden and bedrock;
  - A landslide and slope stability risk assessment for the site for all stages of the project, with proposed mitigation measures where

appropriate (this should also consider the possible effects of storage of excavated material);

- An assessment of whether the development could create a bog burst or landslide hazard;
- Location of the site in relation to any area or site that has been identified as an important geological site or area and the potential impacts of the proposal on the geological resource.
- Location of the site in relation to areas of significant mineral or aggregate potential;
- An assessment of any potential impacts of the development on groundwater; and
- Details of any borrow-pits proposed on site should be shown on the planning application and details given where blasting is proposed, such as on the avoidance and remediation of land slippage (if so are there any impacts discussed or mitigation methods proposed).

A72. In order to ensure that the above issues have been fully addressed, a developer should consult with the Geological Survey of Northern Ireland and obtain professional advice/source reports from suitably qualified geotechnical engineers, engineering geologists or geologists as appropriate. If upland sites are proposed, the application should be accompanied by a statement from a geologist, a hydro-geologist or an engineer with expertise in soil mechanics.

### **Archaeology and the Built Heritage**

A73. Planning Policy Statement 6 Planning, Archaeology and the Built Heritage sets out planning policy for the protection and conservation of archaeological remains and features of the built heritage.

A74. The potential impact of the proposed wind energy development on the archaeological heritage of the site should be assessed. The assessment should address direct impacts on the integrity, visual amenity, and setting of individual sites and monuments or any location designated as an Area of Significant Archaeological Interest. It should also detail appropriate mitigation measures, such as through a desktop study and a field inspection where necessary.

A75. An assessment should be made on the potential impact of the proposed wind energy development on the wider built heritage of the locality and its landscape context, where relevant. This is particularly necessary in the case of structures impacting on Listed Buildings; Historic Parks, Gardens and Demesnes; Conservation Areas; and Areas of Townscape Character.

### **Noise**

A76. Well designed wind farms should be located so that increases in ambient noise levels around noise-sensitive developments are kept to acceptable levels with relation to existing background noise. This will

normally be achieved through good design of the turbines and through allowing sufficient distance between the turbines and any existing noise-sensitive development so that noise from the turbines will not normally be significant. Noise levels from turbines are generally low and, under most operating conditions, it is likely that turbine noise would be completely masked by wind-generated background noise. Table 1 below indicates the noise generated by wind turbines, compared with other every-day activities.

**Table 1  
Noise generated by wind turbines compared with other everyday activities**

<b>Source / Activity</b>	<b>Indicative noise level dB(A)</b>
Threshold of pain	140
Jet aircraft at 250m	105
Pneumatic drill at 7m	95
Truck at 30mph at 100m	65
Busy general office	60
Car at 40mph at 100m	55
<b>Wind farm at 350m</b>	<b>35-45</b>
Quiet bedroom	35
Rural night-time background	20-40
Threshold of hearing	0

- A77. There are two quite distinct types of noise source within a wind turbine. The mechanical noise produced by the gearbox, generator and other parts of the drive train; and the aerodynamic noise produced by the passage of the blades through the air. Since the early 1990s there has been a significant reduction in the mechanical noise generated by wind turbines and it is now usually less than, or of a similar level to, the aerodynamic noise. Aerodynamic noise from wind turbines is generally unobtrusive – it is broad-band in nature and in this respect is similar to, for example, the noise of wind in trees.
- A78. Wind-generated background noise increases with wind speed, and at a faster rate than the wind turbine noise increases. The difference between the noise of the wind farm and the background noise is therefore liable to be greatest at low wind speeds. Varying the speed of the turbines in such conditions can, if necessary, reduce the sound output from modern turbines.
- A79. The report, ‘The Assessment and Rating of Noise from Wind Farms’ (ETSU-R-97), describes a framework for the measurement of wind farm noise and gives indicative noise levels calculated to offer a reasonable degree of protection to wind farm neighbours, without placing unreasonable restrictions on wind farm development. The report presents the findings of a cross-interest Noise Working Group and makes a series of recommendations that can be regarded as relevant guidance on good practice. This methodology overcomes

some of the disadvantages of BS 4142 when assessing the noise effects of windfarms, and will be used in the assessment and rating noise from wind energy developments.

## **Recommended Good Practice on Controlling Noise from Wind Turbines**

### **From 'The Assessment and Rating of Noise from Wind Farms' (ETSU for DTI 1997).**

The current practice on controlling wind farm noise by the application of noise limits at the nearest noise-sensitive properties is the most appropriate approach.

Noise limits should be applied to external locations and should apply only to those areas frequently used for relaxation or activities for which a quiet environment is highly desirable.

Noise limits set relative to the background noise are more appropriate in the majority of cases. Generally, the noise limits should be set relative to the existing background noise at the nearest noise-sensitive properties and the limits should reflect the variation in both turbine source noise and background noise with wind speed.

It is not necessary to use a margin above background noise levels in particularly quiet areas. This would unduly restrict developments that are recognised as having wider national and global benefits. Such low limits are, in any event, not necessary in order to offer a reasonable degree of protection to wind farm neighbours.

Separate noise limits should apply for day-time and for night-time as during the night the protection of external amenity becomes less important and the emphasis should be on preventing sleep disturbance.

Absolute noise limits and margins above background should relate to the cumulative effect of all wind turbines in the area contributing to the noise received at the properties in question. Any existing turbines should not be considered as part of the prevailing background noise.

Noise from the wind farm should be limited to 5 dB(A) above background for both day- and night-time, remembering that the background level of each period may be different.

The  $L_{A90,10min}$  descriptor should be used for both the background noise and the wind farm noise, and when setting limits it should be borne in mind that the  $L_{A90,10min}$  of the wind farm is likely to be about 1.5-2.5 dB(A) less than the  $L_{Aeq}$  measured over the same period. The use of the  $L_{A90,10min}$  descriptor for wind farm noise allows reliable measurements to be made without corruption from relatively loud, transitory noise events from other sources.

A fixed limit of 43 dB(A) is recommended for night-time. This is based on a sleep disturbance criteria of 35 dB(A) with an allowance of 10 dB(A) for attenuation through an open window (free field to internal) and 2 dB(A) subtracted to account for the use of  $L_{A90,10min}$  rather than  $L_{Aeq,10min}$ .

Both day- and night-time lower fixed limits can be increased to 45 dB(A) to increase the permissible margin above background where the occupier of the property has some financial interest in the wind farm.

In low noise environments the day-time level of the  $L_{A90,10min}$  of the wind farm noise should be limited to an absolute level within the range of 35-40 dB(A). The actual value chosen within this range should depend upon: the number of dwellings in the neighbourhood of the wind farm, the effect of noise limits on the number of kWh generated, and the duration of the level of exposure.

For single turbines or wind farms with very large separation distances between the turbines and the nearest properties, a simplified noise condition may be suitable. If the noise is limited to a  $L_{A90,10min}$  of 35 dB(A) up to wind speeds of 10 m/s at 10 m height, then this condition alone would offer sufficient protection of amenity, and background noise surveys would be unnecessary.

### **Low Frequency Noise (Infrasound)**

- A80. There is no evidence that ground transmitted low frequency noise from wind turbines is at a sufficient level to be harmful to human health. A comprehensive study of vibration measurements in the vicinity of a modern wind farm was undertaken in the UK in 1997 by ETSU for the DTI (ETSU W/13/00392/REP). Measurements were made on site and up to 1km away – in a wide range of wind speeds and direction.
- A81. The study found that:
- Vibration levels 100m from the nearest turbine were a factor of 10 less than those recommended for human exposure in critical buildings (i.e. laboratories for precision measurement); and
  - Tones above 3.0 Hz were found to attenuate rapidly with distance – the higher frequencies attenuating at a progressively increasing rate.

### **Safety**

- A82. Experience indicates that properly designed and maintained wind turbines are a safe technology. The very few accidents that have occurred involving injury to humans have been caused by failure to observe manufacturers' and operators' instructions for the operation of the machines. There has been no example of injury to a member of the public.
- A83. The only source of possible danger to human or animal life from a wind turbine would be the loss of a piece of the blade or, in most exceptional circumstances, of the whole blade. Many blades are composite structures with no bolts or other separate components. Blade failure is therefore most unlikely. Even for blades with separate control surfaces on or comprising the tips of the blade, separation is most unlikely.
- A84. The minimum desirable distance between wind turbines and occupied buildings calculated on the basis of expected noise levels and visual impact will usually be greater than that necessary to meet safety requirements. Fall over distance (i.e. the height of the turbine to the tip of the blade) plus 10% is often used as a safe separation distance.

### **Proximity to Road and Railways**

- A85. Applicants are advised to consult at an early stage with DRD Roads Service for development affecting public roads. In the case of railway lines consultation should take place with Translink.
- A86. Although wind turbines erected in accordance with best engineering practice are considered to be stable structures, they should be set-back at least fall over distance plus 10% from the edge of any public

road, public right of way or railway line so as to achieve maximum safety.

- A87. Concern is often expressed over the effects of wind turbines on car drivers, who may be distracted by the turbines and the movement of the blades. Drivers are faced with a number of varied and competing distractions during any normal journey, including advertising hoardings, which are deliberately designed to attract attention. At all times drivers are required to take reasonable care to ensure their own and others' safety. Wind turbines should therefore not be treated any differently from other distractions a driver must face and should not be considered particularly hazardous. The provision of appropriately sited lay-bys for viewing purposes may be helpful in giving an opportunity to view the wind energy development in safety; lay-by size should be adequate to cater for tour buses.

### **Proximity to Power Lines**

- A88. Wind turbines should be separated from overhead power lines in accordance with the Energy Networks Association standard TS 43-8 issue 3 'Overhead Line Clearances'.

### **Lightning Strike**

- A89. The possibility of attracting lightning strikes applies to all tall structures and wind turbines are no different. Appropriate lightning protection measures are incorporated in wind turbines to ensure that lightning is conducted harmlessly past the sensitive parts of the nacelle and down into the earth.

### **Electromagnetic Production and Interference**

- A90. Wind turbines contain electrical machines producing power. They will therefore also produce electromagnetic radiation. This is at a very low level, and presents no greater risk to human health than most domestic appliances.
- A91. Provided careful attention is paid to siting, wind turbines should not cause any significant adverse effects on communication systems which use electromagnetic waves as the transmission medium (e.g. television, radio, telecommunication links, and police and emergency service links). Generally, turbine siting can mitigate any potential impacts, as the separation distance required to avoid problems is generally a matter of a few hundred metres. In some cases, it may be possible to effectively re-route the signal around the development, at the developer's expense, to overcome the problem.
- A92. Scattering of signal mainly affects domestic TV and radio reception, and the general public may be concerned that a wind farm will interfere with these services. Experience has shown that when this occurs it is

of a predictable nature and can generally be alleviated by the installation or modification of a local repeater station or cable connection.

- A93. Specialist organisations responsible for the operation of the electromagnetic links typically require a 100m clearance either side of a line of sight link from the swept area of turbine blades although some operators are willing to accept Fresnel zones<sup>8</sup> of avoidance. Individual consultations would be necessary to identify each organisation's safeguarding distance. Effects on such links can usually be resolved through careful siting of individual turbines
- A94. Since a large number of bodies use communication systems, and some of the users are commercially sensitive or of strategic importance, it is often difficult to obtain a definitive picture of all the transmission routes across a potential site. The Office of Communications (OFCOM) holds a central register of all civil radio communications operators in the UK and acts as a central point of contact for identifying specific consultees relevant to a site. OFCOM will identify any radio installations relevant to a wind farm site. Although OFCOM passes any enquiry on to other interested parties, who should respond to an application, this process is only partial and an applicant seeking planning permission would be well advised to make direct contact with any authorities/bodies which are likely to be interested – a list of potentially interested parties is given at the end of this Section.
- A95. In addition, it may be necessary to consult utility providers and also emergency services such as the police, ambulance service and the coastguard.
- A96. For proposals within 20km of the Republic of Ireland it is recommended that developers consult with licensed operators there. A list of these operators is available on the ComReg website at [www.comreg.ie](http://www.comreg.ie). In such cases it is also advisable to contact Irish mobile phone operators.

### **Aviation Interests**

- A97. Wind turbines may have an adverse affect on two aspects of air traffic movement and safety. Firstly, they may represent a risk of collision with low flying aircraft, and secondly, they may interfere with the proper operation of radar by limiting the capacity to handle air traffic, and aircraft instrument landing systems.

#### *Risk of Collision*

- A98. Risk of collision is likely to occur close to civilian and military airfields, and in military low flying zones. As appropriate, the Department

---

<sup>8</sup> The area around the visual line-of-sight that radio waves spread out into after they leave the antenna.

consults with the relevant licensed operators of civil airports/airfields, the Ministry of Defence (MOD) and the National Air Traffic Service (NATS) on all proposals for wind turbine developments in Northern Ireland. The Civil Aviation Authority (CAA) can inform the applicant of any civilian airfields that are likely to be affected, but it is the responsibility of the applicant to consult the airfield management at the airfield in question. It is recommended that such consultation should occur prior to submission of an application and the applicant should take account of the airfield management's requirements, which will depend on local topography and the preferred flight paths at the site.

A99. In the interests of aviation safety, lights may be required on wind turbine development and is mandatory in all cases where the structure exceeds 150m high. In addition, structures over 91.4m (300ft) are required to be charted on aviation maps. Developers will be required to provide details of the development to the Defence Geographic Centre.

A100. There is currently no low flying training undertaken by the MOD in Northern Ireland.

*Radar*

A101. Any large structure is liable to show up on radar, but wind turbines can present a particular problem as they can be interpreted by radar as a moving object, which is only intermittently seen (as the nacelle rotates to face the wind). There is a consultation zone and an advisory zone around every civilian and military air traffic radar but objections may sometimes be raised in respect of developments further afield. Consultation by the developer will also be required in respect of any meteorological radar. Developers therefore need to carefully consider this matter and the British Wind Energy Association web site gives details of how adequate consultation can be achieved. In addition, developers may be required to contact the Irish Aviation Authority at the pre-planning stage with details of locations and proposed heights of turbines, to ensure that the proposed development will not cause difficulties with air navigation safety in the Republic of Ireland.

A102. Because topography, intervening buildings and even tree cover can mitigate the effect of wind turbines on radar, it does not necessarily follow that the presence of a wind turbine in a safeguarding zone will have a negative effect. However, if an objection is raised by either a civil aviation or Defence Estates consultee, the onus is on the applicant to prove that the proposal will have no adverse effect on aviation interests.

A103. The CAA has published a Civil Aviation Publication, CAP 764 CAA Policy and Guidelines on Wind Turbines (July 2006) to provide assistance to aviation stakeholders when addressing wind energy related issues. This seeks to ensure greater consistency across the whole aviation industry in the consideration of the potential impact of proposed wind turbine developments.

### **Shadow Flicker and Reflected Light**

A104. Under certain combinations of geographical position and time of day, the sun may pass behind the rotors of a wind turbine and cast a shadow over neighbouring properties. When the blades rotate, the shadow flicks on and off; the effect is known as 'shadow flicker'. It only occurs inside buildings where the flicker appears through a narrow window opening. A single window in a single building is likely to be affected for a few minutes at certain times of the day during short periods of the year. The likelihood of this occurring and the duration of such an effect depends upon:

- the direction of the residence relative to the turbine(s);
- the distance from the turbine(s);
- the turbine hub-height and rotor diameter;
- the time of year;
- the proportion of day-light hours in which the turbines operate;
- the frequency of bright sunshine and cloudless skies (particularly at low elevations above the horizon); and,
- the prevailing wind direction.

Only properties within 130 degrees either side of north, relative to the turbines can be affected at these latitudes in the UK – turbines do not cast long shadows on their southern side.

A105. The further the observer is from the turbine the less pronounced the effect will be. There are several reasons for this:

- there are fewer times when the sun is low enough to cast a long shadow;
- when the sun is low it is more likely to be obscured by either cloud on the horizon or intervening buildings and vegetation; and,
- the centre of the rotor's shadow passes more quickly over the land reducing the duration of the effect.

A106. At distance, the blades do not cover the sun but only partly mask it, substantially weakening the shadow. This effect occurs first with the shadow from the blade tip, the tips being thinner in section than the rest of the blade. The shadows from the tips extend the furthest and so only a very weak effect is observed at distance from the turbines.

A107. Problems caused by shadow flicker are rare. At distances greater than 10 rotor diameters from a turbine, the potential for shadow flicker is very low. The seasonal duration of this effect can be calculated from the geometry of the machine and the latitude of the site. Where shadow flicker could be a problem, developers should provide calculations to quantify the effect and where appropriate take measures to prevent or ameliorate the potential effect, such as by turning off a particular turbine at certain times.

A108. Careful site selection, design and planning, and good use of relevant software, can help avoid the possibility of shadow flicker in the first instance. It is recommended that shadow flicker at neighbouring offices and dwellings within 500m should not exceed 30 hours per year or 30 minutes per day<sup>9</sup>.

A109. Turbines can also cause flashes of reflected light, which can be visible for some distance. It is possible to ameliorate the flashing but it is not possible to eliminate it. Careful choice of blade colour and surface finish can help reduce the effect. Light grey semi-matt finishes are often used for this. Other colours and patterns can also be used to reduce the effect further. (See 'The Influence of Colour on the Aesthetics of Wind Turbine Generators' – ETSU W/14/00533/00/00).

### **Ice Throw**

A110. The build-up of ice on turbine blades is unlikely to present problems on the majority of sites in Northern Ireland. Even where icing does occur the turbines' own vibration sensors are likely to detect the imbalance and inhibit the operation of the machines.

### **Recreation and Tourism**

A111. In many areas in Northern Ireland, recreation and tourism are a significant element of the local economy and can depend to varying degrees on the quality of the environment. It is not considered that wind energy developments are incompatible with tourism and leisure interests, but it is acknowledged that care does need to be taken to ensure that insensitively sited wind energy developments do not impact negatively on tourism potential. The results of survey work conducted in 2003 in the Republic of Ireland indicate that tourism and wind energy can co-exist happily<sup>10</sup>.

A112. For future wind farms, the judgment of acceptability based on landscape protection should provide adequate protection for tourism interests. The threshold of landscape protection is generally more sensitive to wind farm development than tourism, therefore if there is deemed to be acceptable within the landscape at the planning stage, there will be no unreasonable impacts on tourism interests.

A113. The educational potential of wind energy developments should also be considered. For example, there may be scope for interpretive centres

---

<sup>9</sup> The shadow flicker recommendations are based on research by Predac, a European Union sponsored organisation promoting best practice in energy use and supply which draws on experience from Belgium, Denmark, France, the Netherlands and Germany.

<sup>10</sup> Attitudes Towards the Development of Wind Farms in Ireland – Sustainable Energy Ireland, 2003

on alternative energy resources to be located at accessible locations in proximity to some wind energy developments. It would be helpful if established long distance walking routes/amenity rights-of-way were identified and mapped to enable an assessment both of the extent to which recreational pursuits can be accommodated and facilitated either within or adjacent to wind energy developments.

### **Construction and Operational Disturbance**

A114. The degree of disturbance caused by the construction phase of a wind farm will depend on the number of turbines and the length of the construction period. Public perception of the construction phase will derive mainly from physical impact and traffic movements. The traffic movements to be expected will involve:

- vehicles bringing aggregate to the site including concrete for foundations;
- vehicles removing spoil from the site;
- vehicles (which may be articulated) bringing turbine components to the site;
- the vehicles of those working on the site; and,
- the crane(s) to erect the turbines.

A115. Although construction traffic for a wind turbine development will essentially be no different from other developments, many turbines will be sited in areas served by the minor road network. In such cases, it may be necessary to impose suitable conditions on consents or enter a legal agreement with the developer to control the number of vehicle movements to and from the site in a specified period and, where possible, the route of such movements, particularly by heavy vehicles. Further requirements for strengthening bridges may also be required by the DRD Roads Service. Where culverting of any watercourse under site roads is planned, the provisions of Planning Policy Statement 15 Planning and Flood Risk will be taken into account. Consent from the Department of Agriculture and Rural Development's Rivers Agency will also be required.

A116. Once turbines are in operation, traffic movements to and from the site will be very light, probably averaging two visits a week by a light commercial vehicle or car. The need to replace machine components will generate heavier commercial vehicle movements, but these are likely to be infrequent.

### **Decommissioning and Reinstatement**

A117. The decommissioning of a wind energy development once electricity ceases to be generated will need to be assessed. Plans for decommissioning should be outlined at the planning application stage. Issues to be addressed include restorative measures, the removal of above ground structures and equipment, landscaping and/or reseedling

roads. On occasion it may be appropriate to allow tracks to remain, e.g., as part of a walking route after decommissioning.

A118. A decommissioning plan may be covered in conditions and/or a legal agreement accompanying planning permission and will be triggered by the expiry of the consent or in the event of the project ceasing to operate for a specified period. Developers should demonstrate that funding to implement decommissioning will be available when required.

A119. It is likely that the duration of the planning permission will be linked to the expected operational life of the turbines. However during this period, proposals may be forthcoming to extend the life of the project by re-equipping or to replace the original turbines with new ones. While there are obvious advantages in utilising established sites, such cases will have to be determined on their individual merit and in the light of the then prevailing policy and other relevant considerations.

### **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

A120. The developer should submit the following to accompany a wind energy application:

- 7 copies of the P1 Planning Application form, accurately completed, signed and dated;
- planning fee (currently £200 per 0.1ha or part thereof of the footprint of the development up to a maximum of £10,000);
- 7 copies of the site location map with site boundary, including the access road and land for any junction improvement outlined in red;
- 7 copies of the site layout including access roads within the site, detailed plans to scale including turbines, details of bases, access roads, wind monitoring masts, sub-stations and other ancillary development. Details of finishing materials (e.g. on turbines, sub-stations, control rooms, fences and other structures), landscaping etc. are required. Information will also be required detailing spoil storage and the location of any construction compound.

A121. Where wind energy proposals are deemed as EIA developments, the developer is also required to submit sufficient copies of the EIA statement to enable the Department to carry out consultations. The developer should contact the Department to ascertain the numbers of statements required and the format preferred.

A122. For smaller developments that do not require a full EIA, the Department will often still require some or all of the issues set out in paragraph A36 to be addressed through an environmental report to accompany the planning application to include for example a report detailing noise emissions and an assessment of the impact.

## **Environmental Impact Assessment**

- A123. Wind turbines fall within descriptions of development listed under Schedule 2, category 3(j) to the EIA Regulations. The Department of the Environment is required to screen applications for the need for EIA where the development involves the installation of more than 2 turbines or the hub height of any turbine or height of any other structure exceeds 15 metres.

## **OTHER AUTHORISATIONS/CONSENTS**

### **Grid Connection**

- A124. Where the works required to connect the wind farm to the local electricity distribution network are not permitted under the General Development Order it will be necessary to submit a separate planning application<sup>11</sup>. Either NIE or the wind farm developer may make such an application. Developers should provide information on the most likely route and method for the grid connection (overground or underground) to the wind farm with their planning application and as part of any EIA. The connection of the wind farm to the electricity grid forms an intrinsic part of the project and both can be considered together.

## **CONSULTEES**

- A125. Wind energy developers may wish to refer to the Department's consultees:
- **Belfast International Airport** - Belfast BT29 4AB
  - **Chief Executive**, Local Government Authority
  - **City of Derry Airport** - Airport Road, Eglington BT47 3GY
  - **Council for Nature Conservation and the Countryside** - 5-33 Hill Street, Belfast, BT1 2LR
  - **Defence Communication Services Agency** - Room 4 Building 56, South Site, RAF Henlow, Bedfordshire, SG16 6DN
  - **Defence Estates Organisation** - Safeguarding Bylaws, Blakemore Drive, Sutton Coldfield, West Midlands, B75 7RL
  - **Department of Agriculture and Rural Development** - Environmental Policy, Room 657, Dundonald House, Upper Newtownards Road, BELFAST, BT4 3SB
  - **Department of Agriculture and Rural Development** – Policy Development Branch, Room 355, Dundonald House, Upper Newtownards Road, BELFAST, BT4 3SB
  - **Department of Culture Arts & Leisure** - Dept of Culture Arts & Leisure, Inland Fisheries Branch, Interpoint, 20-24 York Street, Belfast, BT15 1AQ

---

<sup>11</sup> Please note responsibility for determining consent and granting deemed planning permission for the installation of overhead lines which have a nominal voltage of over 20 kilovolts associated with wind farms is planned to transfer to the Department of Enterprise Trade and Investment.

- **Department of Enterprise, Trade and Investment** - Energy Branch, Netherleigh, Massey Avenue, Belfast
- **Enniskillen (St. Angelo) Airport** - Trory, Enniskillen BT94 2FP
- **Environment and Heritage Service** - Natural Heritage, Klondyke Building, Cromac Avenue, Gasworks Business Park, Lower Ormeau Road, Belfast BT7 2JA
- **Environment and Heritage Service** - Protecting Historic Monuments, 5-33 Hill Street, BELFAST, BT1 2LR
- **Environment and Heritage Service** - Water Management Unit, 17 Antrim Road, Lisburn, BT28 3AL
- **Environmental Health Officers**, Local District Council
- **Fisheries Conservancy Board for Northern Ireland** - HQ Office, 1 Mahon Road, PORTADOWN, BT62 6EE
- **Geological Survey (NI)** - 20 College Gardens, BELFAST, BT9 6BS
- **George Best Belfast City Airport** - Belfast BT3 9JGH
- **Health & Safety Inspectorate** - 83 Ladas Drive, Belfast, BT6 9FR
- **Loughs Agency** - 22 Victoria Road, Londonderry BT47 2AD
- **National Air Traffic Service** - Navigation, Spectrum & Surveillance, Spectrum House, Gatwick, West Sussex, RH6 0LG
- **Newtownards Airport** - Ulster Flying, Portaferry Road, Newtownards BT23 8SG
- **Northern Ireland Electricity** - NIE Powerteam Ltd, Fortwilliam House, Edgewater Office Park, Edgewater Road, Belfast, BT3 9LQ
- **Northern Ireland Tourist Board** - St Anne's Court, 59 North Street, BELFAST, BT1 1ND
- **OFCOM** - Riverside House, 2a Southwark Bride Road, London, SE1 9HA
- **Roads Service** – Local Divisional Office
- **Royal Society for the Protection of Birds** - Belvoir Forest, Belvoir Park, Belfast, BT8
- **Spectrum Planning** - National Grid Wireless, Wireless House, Warwick Tech. Park, Heathcote Lane, Warwick CV34 6DD
- **Virgin Media** - Crawley Court, Winchester, Hampshire, SO21 2QA
- **Water Service** – Local Divisional Office

## **B. Biomass**

### **INTRODUCTION**

- B1. This section describes the technology involved in exploiting biomass and energy crops as a fuel on a commercial scale in its variety of forms, and outlines the main planning and environmental implications.
- B2. Biomass fuels can be categorised as either dry or wet. The energy conversion of dry biomass generally involves heat, whereas the conversion of wet biomass generally involves fermentation or digestion. Because of the two distinct technological approaches, this section deals with dry biomass fuels. Section C deals with wet biomass technologies, such as anaerobic digestion.
- B3. The principal dry biomass fuel sources are as follows:
- Forestry – co-product from existing forestry operations (small diameter roundwood (SDR), branches, lop and top);
  - Energy crops (short rotation coppice willow and poplar (SRC), Miscanthus and other energy grasses);
  - Primary processing co-product (sawdust, slabwood, points etc);
  - Clean wood waste from industry (e.g. pallets, furniture manufacture);
  - Other crops and bi-products (e.g. whole cereal crops and straw);
  - Poultry litter; and
  - Biodegradable fraction of Municipal Solid Waste (MSW).
- B4. Dry biomass differs from most other sources of renewable energy to the extent that the fuel can be grown rather than harnessed, and it gives off carbon dioxide when burned. However, these fuels are regarded as 'carbon neutral', because the carbon released on combustion is only that which was absorbed during crop growth – the gas is simply recycled. So, when it is used in combustion in place of fossil fuels, a net reduction in carbon emissions is achieved.
- B5. There are currently three basic categories of biomass plant:
- Plant designed primarily for the production of electricity. These are generally larger schemes, in the range 10 to 40MW. Excess heat from the process is not utilised. Typically, 1 MW of electricity generated would require around 4MW of thermal input;
  - Combined Heat and Power (CHP) plant. The primary product of these is the generation of electricity, but the excess heat is used productively, for instance as industrial process heat or in a district heating scheme. The typical size range for CHP is 5 to 30 MW thermal total energy output, but some smaller schemes of a few hundred kilowatts have been built in the UK; and,
  - Plant designed for the production of heat. These cover a wide range of applications, including single dwelling domestic or district heating, commercial and community buildings, and industrial

process heat. The size can range from a few kilowatts, to above 5MW thermal.

- B6. While currently liquid biofuels such as biodiesel and bioethanol are produced from cereal starch, sugar crops and vegetable oils technologies which will enable biofuels to be produced from ligno-cellulosic materials such as wood and straw are likely to become commercially viable. With the impetus of EU directives and Government incentives, it is likely that in the future liquid transport fuels produced from these biomass sources will become significant.

## **TECHNOLOGY**

- B7. Energy generation based on biomass is technologically well advanced and widely utilised in many parts of the world.
- B8. There are three main methods for converting dry biomass fuels into energy:
- Direct combustion is used for heating water or to raise steam to drive a steam engine or turbine to generate electricity (steam cycle). Equipment ranges from very small wood stoves used for domestic heating to multi-megawatt plants for electricity production. The upper limit is restricted by local energy demand and availability of biomass rather than by combustion technology. Equipment design depends on the moisture content and particle size of the fuel;
  - Gasification is a technique in which the solid fuel undergoes incomplete combustion in a limited air supply to produce a combustible gas that can be burned in a boiler, or used as fuel for an engine or gas turbine. This technology is more applicable to multi megawatt plants, but smaller plants of under 5 MW are becoming more common; and
  - Pyrolysis involves heating in the absence of oxygen (rather like traditional charcoal production) to produce a combustible gas or liquid, which is used in a similar way to gas produced from gasification.
- B9. Direct combustion is the most commonly used technology for 'heat only' plants, whilst both direct combustion and gasification are used for CHP and 'electricity only' plants. Pyrolysis is more commonly associated with the production of transport fuel, such as biodiesel. Combustion technology and generation of electricity using the steam cycle is an advanced, mature technology. Whilst becoming much more common, gasification and pyrolysis are much less mature technologies than direct combustion.
- B10. The three technologies appear externally to be similar, and share much in common from a planning perspective. For a given capacity of plant, the size, extent and appearance of the development will be similar, similar amounts of fuel feedstock will be required, and emissions and

other waste products will be similar, although pyrolysis and gasification plant may have a smaller footprint, as the process is more compact.

### **Fuel Sources**

- B11. Although this section deals with the planning implications of the energy conversion plant itself, and not of the fuel supply, some reference to the different sources is important. There are five main sources of biomass fuel:
- material from forestry harvesting;
  - material from timber processing;
  - agricultural residues;
  - energy crops; and
  - waste streams.

A large biomass scheme may use fuel from one or more sources, in order to ensure security of supply.

- B12. All the 'dry' biomass fuels listed above have a broadly similar gross energy content. How much of this energy content can be exploited depends on the process, the technology employed, and the moisture content. Some direct combustion technologies can use fuel with a high moisture content (up to 50%), but gasification and pyrolysis generally require fuel to have a moisture content of less than 30%, and fuel may have to be dried as part of the process.
- B13. Biomass material from forestry harvesting, agricultural residues and energy crops may have a similar supply strategy. Most biomass plants require fuel to be in a chipped form, and chipping often occurs close to where the crop is grown. Once chipped, fuel tends to deteriorate fairly quickly, hence fuel in long term storage (e.g. inter-seasonal) is usually left in the 'as harvested' state, either in situ, or in converted agricultural buildings. Chipped fuel is often loaded directly onto lorries for delivery to the energy plant. Generally, only short term storage facilities are provided at the energy plant, and regular fuel deliveries are needed. A useful rule of thumb for fuel deliveries is two 38 tonne lorry deliveries per day, per MW thermal continuous heat input. Thus, a 250kW boiler operating for half of the time (a duty cycle of 50%), supplying heat to a leisure development would require 1 or 2 deliveries a week, and a 10MW plant producing electricity continuously would require around 20 deliveries a day.
- B14. Existing large coal fired power stations can use biomass to augment the traditional fuel. This is known as 'co-firing'. Although this may not have implications for the planning system, it is an important way of increasing the critical mass of producers in the fuel supply chain.

### **Residues from forestry harvesting**

- B15. Forestry co-product harvesting makes use of those parts of the tree which, with conventional timber extraction and tree thinning, are normally left on the forest floor. The tops and branches of a tree are known as brash, and can account for 30-40 per cent of the gross weight of a conifer crop and over 50 per cent of the weight of a deciduous crop. Not all brash is available as biomass feedstock, as environmental impacts, extraction methods and ground conditions may render it unusable or undesirable to use.
- B16. Whole tree comminution is the mechanical felling and chipping of whole small trees, usually undertaken in thinning operations. The main product is wood fuel chips, although higher value 'white' stemwood chips can be screened out for use in the wood processing industry. The use of SDR is becoming the preferred option for most forestry operators, due to diversification into new markets.
- B17. Integrated harvesting is the mechanical extraction and processing of whole trees in a single operation. The tree is separated into stem wood and fuel wood products on site. This method leaves clear ground that can be immediately replanted and is considered to offer the most significant long term potential for the cost-effective harvesting of fuel wood. However, whole tree harvesting is not appropriate on all sites, and on some sites loss of nutrients and organic matter as well as soil compaction can be a significant factor.
- B18. Although most of the fuel in this category arises from commercial softwood production, the use of arisings from the management of smaller hardwood woodlands can also be important to the rural economy, and can form a significant proportion of a small biomass heating plant in a rural area. It has the added advantage of providing another source of income for small woodland owners and farmers.

### **Co-Product from timber processing**

- B19. Untreated co-products from industries such as saw milling, or production of fencing, including off-cuts, sawdust and wood shavings often form the basis of the fuel supply for a project. In some cases, a biomass plant that is associated with an existing industry may be proposed, either to supply heat for the industry itself (e.g. for kiln drying of timber) or as a separate activity.

### **Agricultural sources of biomass**

- B20. The most commonly used fuels in this category are straw (which should be viewed as an agricultural product, rather than a residue) and chicken litter. Straw is utilised in whole bale form, and is generally sourced from within a 50 mile radius of the plant. Chicken litter consists of a mixture of wood shavings, straw or other bedding material and

poultry droppings. It is a good fuel for electricity generation with nearly half the calorific value of coal.

### **Biomass Fuel Pellets**

- B21. Most of the biomass materials which have been discussed can be incorporated into fuel pellets which are particularly suited to domestic scale boilers. While pelleting significantly adds to the cost of the fuel it renders it into a form which can be bagged and marketed as a retail product. The number of pellet burning boilers installed in the Northern Ireland has been increasing rapidly and this has led to supply and demand problems. A significant proportion of fuel pellets used in Northern Ireland are imported

### **Energy crops**

- B22. Energy crops are renewable materials which can substitute for fossil fuels. They offer the opportunity for the full potential of biomass to contribute to meeting renewable energy targets. The most common energy crop grown in Northern Ireland is short rotation coppice willow.
- B23. Short rotation coppice willow (SRC) is a specialised form of forestry plantation and involves growing willow at close spacing and harvesting at regular intervals (normally every second or third year). The crop is established during the Spring (March – June) by planting around 15,000 cuttings per hectare. After one year these are cut back close to the ground, which causes them to form multiple shoots (i.e. to coppice). The crop is then allowed to grow for 2-4 years, after which time the fuel is harvested by cutting the stems close to the soil level. The cut stems again form multiple shoots that grow on for a further cycle to become the next harvest. This cycle of harvest and re-growth can be repeated many times, up to an expected lifespan of 15-20 years. The shoots are usually harvested during the winter as chips, short billets or as whole stems, 25-50mm diameter and 3-4 metres long.
- B24. Other energy crops of interest in Northern Ireland include oilseed rape, energy grasses and cereals grown for energy production,. For example miscanthus, canary reed grass and switchgrass have been the subject of recent trials in Northern Ireland. Of these the most promising to date has been miscanthus. It is of tropical origin and uses sunlight more efficiently to produce higher yields than native plants. It grows well in the south of the UK but is also being successfully grown towards the North of England and in Ireland. It is similar to coppice in that it is perennial, and harvested in the winter, but on a one year cycle compared to 2-4 for SRC. The fuel has a similar calorific value per unit weight as wood and could possibly be used in the same power plant or those designed for agricultural residues. The potential advantages compared to SRC are that the harvested fuel is relatively dry, standard agricultural equipment can be used, and the yield potential is higher

(10-20 oven dried tonnes per ha per year as opposed to around 10 oven dried tonnes per ha per year for SRC).

- B25. Energy crop production will only be viable if the financial rewards and associated risks make it more attractive than existing agricultural enterprises. The experience of producing energy crops on a commercial scale in Northern Ireland is still limited and the establishment costs can be high, especially for SRC. Research carried out by the Forest Service following completion of a Challenge Fund mechanism to support the growing of SRC Willow has provided evidence that the average cost of establishing one hectare of this type of crop is approximately £1950. It has become clear that the economic success of growing SRC is closely linked to proximity of drying and end user facilities to the plantations themselves. It has also been recognised that a minimum area of 3ha should be established in order to produce sufficient material on a regular basis to improve economic viability.

### **Energy Crop Scheme**

From 2004 an Aid to Energy Crops Scheme has been available in Northern Ireland. An aid of €45 per hectare can be payable in respect of energy crops grown. Energy crops are defined as crops supplied essentially for the production of biofuels, and electric and thermal energy produced from biomass (Council Regulation (EC) No 1782/2003 Article 88). Aid is conditional on the producer having a contract in place with a processor. Aid is not payable for energy crops grown on land that is required to be set-aside from production but, as previously allowed, set-aside land can still be used to grow energy crops. Applications for the Aid for Energy Crops Scheme are made on an annual basis and closing date is mid-May each year.

In 2004, the Department of Agriculture and Rural Development (DARD) Forest Service introduced a three year Challenge Fund for SRC energy crops to encourage the establishment of SRC for renewable energy generation. The Challenge Fund operated under the Rural Development Regulation Plan 2000-2006. To date, approximately 400 hectares have been planted or approved for planting under the Scheme and a further 410 hectares have been approved for the 2007 planting year.

At present, the economics of SRC for heat production, without a planting grant, suggest that it could represent a viable alternative enterprise for growers when the price of domestic heating oil is in excess of 35 pence per litre. The attractiveness of SRC as a crop is, however, significantly improved if it can also be used for bioremediation purposes and where the latter activity can either generate an additional income stream (through gate fees) or reduce costs elsewhere on the holding.

The biggest long term constraint on the production of SRC in Northern Ireland is the availability of a local end user (the bulky, low value nature of chipped willow mean that it is necessary to keep transport distances and costs to a minimum). Other constraints have also been identified - proximity to drying equipment, the availability of suitable land in terms of soil type, topography and road access to planting sites.

The three year SRC Challenge Fund has now closed to further applications and has been subject to an initial internal review. Drawing on the findings of this process. DARD Forest Service have recently announced continued support for SRC under the Woodland Grant Scheme.

### **Municipal Solid Waste (MSW)**

- B26. Certain types of MSW are classed, under some circumstances, as renewable energy sources. For combustion technologies the biodegradable fraction of MSW, comprising such items as garden refuse, certain wood waste, and domestic waste paper, can be classed as renewable provided that at least 98% of the fuel is biodegradable. For 'advanced' technologies such as pyrolysis and gasification, any MSW (biodegradable and non degradable) may be used as fuel, but only the biodegradable fraction qualifies as a renewable resource.
- B27. In planning terms, the same issues apply to MSW that apply to other fuel sources, but MSW may fall into a different category under the pollution protection control regime.

### **Additional Products**

- B28. Some technologies and fuels produce products additional to heat and electricity. Pyrolysis projects may produce liquid or solid products for onward sale. Agricultural biomass projects can produce fertiliser.

### **Emission and Waste Products**

- B29. Emissions and waste products from biomass energy production fall into three categories:
- Airborne Emissions
  - Emissions to Watercourses
  - Ash

The Department of the Environment's Planning and Environmental Policy Group and Environment and Heritage Service have responsibility for the control of water quality, water abstraction and all emissions and will be consulted on all development proposals.

### **Airborne Emissions**

- B30. All processes that involve combustion, gasification or pyrolysis give rise to emissions to the air. It is therefore important to consider stack emissions produced by a biomass power plant in the existing environmental context. At the local level, this means comparing them with other sources of emissions and with current air quality. In the broader context, it means comparing the stack emissions from a biomass electricity generating plant with those from a power station fuelled by coal, oil or gas. Carrying out a greenhouse gas emission Life Cycle Analysis (LCA) calculation should be used in this situation.

- B31. Emissions from biomass fuel combustion include limited quantities of gaseous nitrogen and sulphur oxides and carbon dioxide. Emissions of nitrogen and sulphur oxides are significantly less than those from comparable fossil fuel stations. Flue gas is discharged from the plant via a chimney. Under certain conditions (particularly in cold weather) a steam plume may emanate from the chimney. This is non-polluting, the only consideration being the visual effect.
- B32. Biomass fuel combustion may also give rise to particulate emissions from the chimney, known as 'fly ash'. These can be kept within UK and European particulate emission limits using techniques such as cyclone separation, or electrostatic precipitation in the flue.

### **Emissions to Watercourses**

- B33. A generating station may require a supply of water for steam production and condensing. Where water supplies present a problem, air cooling can be employed for steam condensing and other duties – thus reducing net abstraction to low levels. Advanced conversion processes such as gasification and pyrolysis may need lower levels of water use, depending on the technology.
- B34. A generating plant will also have releases to the public sewer system comprising treated boiler drainings and condensate, effluent from the water treatment process and surface water run-off. Effluent from gasification plant may need treatment to remove organic contamination before release to the sewer.
- B35. Large wood chip piles may produce liquids that could leach to watercourses, so a collection ditch may be required around the storage area. With regard to run-off water quality from wood stores, recent research indicates that nitrate concentrations are likely to be well below the 11.3 mg/l NO<sub>3</sub> N maximum for drinking water specified in the Nitrate Directive. NH<sub>4</sub> N concentrations are also likely to be well below the mandatory limits of 1.5 and 4.0 mg/l specified in the Directive.
- B36. The Biological Oxygen Demand (BOD) values of run-off water are likely to be low (10 milligrams per litre) in comparison with agricultural effluent like manure slurry (10,000-30,000 mg/l), raw domestic sewage (300-400mg/l) or treated domestic sewage (20-60 mg/l).

### **Ash**

- B37. The main solid bi-product of the conversion of biomass into energy is ash, usually termed 'bottom ash'. Bottom ash is produced at a rate of around 1 per cent of the total weight of the biomass burned. If residues from forests are used, the inclusion of 'tramp' materials such as soil may increase this ash level to 3-4 per cent. The ash from most fuels, except perhaps MSW, can be safely returned to the soil as a fertiliser.

### **Locational Issues**

- B38. Three main considerations must be taken into account when deciding upon the location of a biomass-fuelled power plant.

#### *Feedstock availability*

- B39. Biomass is a low value, high volume commodity that significantly increases in cost with even short transport distances. For economic and environmental reasons, the ideal maximum transport distance for fuel is therefore about 40 km; for some larger plant, this may be considerably greater, particularly if fuel can be transported by rail or sea. Generally, it is preferable to locate the proposed plant at the 'centre of gravity' of the proposed feedstock. As it may be necessary to seek a variety of feedstocks for a number of reasons including security of supply and regulatory policy, this centre of gravity will inevitably be influenced by the location of the different feedstocks. Main transport conduits or feedstock concentration points (such as ports or railheads) will be preferred locations for the larger plant.

#### *Customers*

- B40. The ability to sell heat directly to an end user has a significant positive effect on the commercial performance of a scheme and therefore it would be very advantageous from an environmental and commercial point of view to locate the scheme close to a potential customer.

#### *Grid Connection*

- B41. Due to cost considerations, the majority of electricity generation projects need to be located close to existing grid infrastructure with the capacity to accept the proposed generation capacity. (It may be possible for a very large plant to bear the cost of infrastructure improvement).

### **Appearance and site footprint**

- B42. The appearance and site footprint depends on the scale of the plant. For example, in the case of a small heat plant for a school, the boiler house could be some 4 metres by 3 metres, with a fuel bunker of similar proportions. The bunker may be semi-underground, only a metre or so protruding above ground, with a lockable steel lid. The chimney will be 3 to 10 metres high, depending on plant design and surrounding buildings. Sufficient space to safely manoeuvre a large lorry or tractor and trailer is required.
- B43. In the case of a larger electricity generating plant, a medium sized industrial building of two-storey height will be required, with a slender chimney of 25 or more metres in height. A Dutch barn scale building may be required for on-site storage of fuel, and additional buildings for offices and workshops may be required. An extensive area for lorry manoeuvring will be needed. Typically, a 1.5MW plant producing electricity using gasification technology will require a site area of some 0.5 hectares and a 40MW plant may require 5 hectares.

## **PLANNING ISSUES**

- B44. The remit of consideration for the planning system is around the power plant and associated impacts and not the production of the fuel source. However, the impacts of growing and collecting the fuel are key to ensuring the successful development of a facility. Many of the environmental issues associated with the fuel supply (e.g. impact on landscape, ecology, archaeology, land use etc) may be covered by an Environmental Impact Assessment (EIA) undertaken by other bodies in connection with the scheme.
- B45. The following issues will be considered when determining an application:
- the positive benefit of the plant to the local economy. The supply of biomass fuel can secure a long-term income for farmers, forestry owners and contractors, and transport operators in rural areas. Some 80 to 90% of operational expenditure on biomass fuel supply can accrue to the local economy;
  - visual intrusion – the plant is an industrial feature with a chimney. In certain weather conditions a plume may be evident from the chimney and/or drying equipment depending upon the design of the equipment;
  - noise from traffic and plant operations. As an industrial development, BS 4142 will usually be the applicable standard;
  - any effects on health, local ecology or conservation from the plant, and airborne and water borne emissions (as discussed above);
  - traffic to and from the site in order to transport biomass fuel and subsequent by-products. Traffic volumes, and the associated noise may increase with the introduction of a large biomass power facility, as the scheme may require a continuous fuel supply; and,
  - greenhouse gas mitigation.

## **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

- B46. The successful development of a biomass-fuelled power plant entails detailed consideration of a wide range of factors and the developer may need to provide information on some if not all of the following matters:
- maps, diagrams and drawings showing the location and design of the plant, and the general location of fuel sources;
  - details of the technology to be employed;
  - in the case of large schemes, a Zone of Visual Impact map of the chimney, and photomontages of the plant from selected viewpoints;
  - details of vehicular access and movements, and principal transport routes for fuel supply;
  - landscaping provisions;
  - details of air and noise emissions and an assessment of their impact;

- report detailing the disposal of residues;
- site management measures during construction; and
- indicative details of grid connection works, including transmission lines and transformers may be useful.

### **Environmental Impact Assessment**

- B47. Schedule 2 to the Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999 lists those developments that must be screened to determine whether they are EIA Development. This type of development is likely to come under either of the following two categories listed under Section 3, “Energy Industry”:
- industrial installations for the production of electricity, steam and hot water, where the development exceeds 0.5 hectare; and
  - industrial installations for carrying gas, steam and hot water, where the area of works exceeds 1 hectare.

It is also possible that where a development will process waste it could fall under Schedule 2.11(c) to the Regulations.

### **OTHER AUTHORISATIONS/CONSENTS**

- B48. In addition to planning permission, a biomass plant may require any of the following authorisations.
- Building Regulations
  - Abstraction License
  - Pollution Control

The Smoke Control Areas (Exempted Fireplaces) Regulations (Northern Ireland) 1999 lists products and technologies permissible within smoke-free zones. Information on smoke-free zones is obtainable from the relevant district council.

## **C. Energy from Waste (biological processes)**

### **INTRODUCTION**

- C1. This section offers guidance on systems using biological processes to extract energy from waste, in terms of their main characteristics, the basic technology and their environmental implications. This covers systems using the following as a fuel to generate heat and/or electricity: landfill gas; sewage gas; biogas from agricultural waste; digestible domestic or industrial waste. All these gases are products of an anaerobic digestion process, which is explained further below. Each process in this section begins by discussing anaerobic digestion in general, and subsequent to this, any differences relating to either sewage gas or landfill gas are described.

### **Anaerobic digestion**

- C2. Anaerobic digestion (AD) is a method of waste treatment that produces a gas with high methane content from organic materials such as agricultural, household and industrial residues and sewage sludge (feedstocks). The methane can be used to produce heat, electricity, or a combination of the two. The process has the benefit of using waste substances that are otherwise difficult to dispose of in an environmentally acceptable manner. Energy from AD is also effectively carbon neutral in that the carbon it releases is approximately equal to the carbon absorbed from the atmosphere by the plants which constitute the origin of the organic waste. It can therefore reduce overall quantities of carbon dioxide released in the atmosphere when it is used to replace energy from fossil fuels. When used for heating, the process is simple, with the minimum pre-treatment of the gas required, and the use of simple, well-proven technology.
- C3. Methane is a significant contributor to global warming (around 21 times more potent than carbon dioxide over a period of 100 years). AD with energy recovery offers an effective means of trapping this gas and converting it to carbon dioxide, which is less potent as a greenhouse gas, while producing a renewable source of energy. By-products of AD may be put to beneficial uses such as compost and liquid fertiliser. Such products can help reduce the demand for synthetic fertilisers and other soil conditioners that may be manufactured using less sustainable methods.
- C4. The AD process has been used widely in the UK agricultural sector in the form of small on-farm digesters producing biogas to heat farmhouses and other farm buildings. An AD project is most likely to be part of an integrated farm waste management system in which the feedstocks and products all play a part. However there is potential for larger scale centralised anaerobic digesters (CADs) using feedstocks imported from a number of sources.

### **Sewage gas**

- C5. Sewage sludge differs from farm waste in that it generally has a far higher inert content (usually >40% of the dry solid matter in sewage is ash). However, as it is only the organic matter that is digested, the gas produced from sewage is of a similar composition to that from farm waste, and the main difference in the digestion plant is one of scale: as sewage waste treatment is generally more centralised, sewage sludge digesters are usually much larger than farm waste digesters.

### **Landfill gas**

- C6. Organic waste materials such as food, paper and garden wastes decompose in landfills to produce landfill gas (LFG), a mixture of methane, carbon dioxide and a wide range of minor components. Using LFG provides energy from a source which would otherwise be flared off or vented to the atmosphere and so wasted.
- C7. The total waste produced in the UK is estimated to be about 434 million tonnes per year. Different types of waste vary immensely in their fuel values and characteristics. Municipal solid waste (MSW) and business waste are the largest potential sources of waste derived energy. However the composition and calorific value of these materials can vary markedly. The proportion sent to landfill will fall in the long term as a result of changes in waste management practices with, for example, increasing recycling. The EU Landfill Directive, implemented in Northern Ireland by the Landfill Regulations (Northern Ireland) 2003, will also progressively ensure the diversion of organic material from landfill, reaching 75% of 1995 levels by 2010; 50% of 1995 levels by 2013 and 35% of levels by 2020. Nevertheless landfill is likely to remain a significant means of waste disposal for some time and the sites will remain biologically active for decades to come.
- C8. The main difference between landfill gas systems and other forms of anaerobic digestion is that the landfill itself is effectively the digester, so there are no constructed tanks for this purpose. However, the generation plant used to extract the gas is broadly similar to that employed for other forms of anaerobic digestion.

## **TECHNOLOGY**

### **Anaerobic digestion**

- C9. AD is the bacterial fermentation of organic waste in warm, oxygen-free conditions. This process converts complex organic molecules into an inflammable gas comprising methane and carbon dioxide, leaving liquid and solid residues. The gas is usually referred to as biogas. During this process, up to 60% of the digestible solids are converted into biogas. This gas can be used to fuel a generator, to supply heating systems, or to serve a range of industrial applications.

- C10. The digestion process takes place in a sealed airless container (the digester) and needs to be warmed and mixed thoroughly to create the ideal conditions for the bacteria to convert the organic matter into biogas. There are two types of AD process:
- Mesophilic digestion. The digester is heated to 30-35°C and the feedstock remains in the digester typically for 15-30 days. Mesophilic digestion tends to be more robust and tolerant than the thermophilic process (see below), but gas production is less, larger digestion tanks are required and sanitisation, if required, is a separate process stage.
  - Thermophilic digestion. The digester is heated to 55°C and the residence time is typically for 12-14 days. Thermophilic digestion systems offer higher methane production, faster throughput, and better pathogen 'kill', but require more expensive technology, greater energy input and a higher degree of operating and monitoring.
- C11. A typical AD plant will comprise waste pre-treatment equipment, a digester tank, buildings to house ancillary equipment such as a generator, a biogas storage tank, a flare stack and associated pipework. If anaerobic digestion is to be carried out on municipal solid waste, pre-treatment facilities will be required to separate organic from inorganic waste. Plants that use sewage sludge or farm slurry will require post-digestion equipment to treat the resulting liquors.

### **Fuel sources**

- C12. The main types of feedstock employed in AD are:
- Sewage sludge. This is the sediment that is removed from foul sewage during the course of treatment by a process of settlement. AD of sewage sludge currently takes place at many sewage treatment works in the UK, and some schemes already include energy recovery. The raising of sewage treatment standards, together with tighter controls on the disposal of sludge, has led to greatly increased arisings, particularly in coastal areas where sludge dumping at sea ceased to be an option in 1998. Water Service are placing a priority on finding alternative methods of safe disposal. Energy recovery will potentially become more economically attractive where AD is the chosen waste treatment measure.
  - Farm slurry. The intensive rearing of livestock, particularly cattle and pigs, produces large quantities of slurry – manure in liquid form – which is not only odorous but which can also present pollution problems if it is not carefully disposed of. Silage effluent can cause similar problems. Farmers can face stiff penalties for causing these substances to pollute watercourses.
  - Municipal solid waste (MSW). Municipal refuse contains large quantities of food, garden waste, paper and packaging with a high organic content, and is therefore suitable for energy extraction via

AD. With the introduction of the Renewables Obligation, the market for CAD plant, utilising 100% food processing waste for example, is large and is likely to grow still further.

- C13. Digestion reduces the volume of the waste and also has the benefits of reducing odour and removing harmful pathogens, which is a particular advantage in the case of farm slurry and sewage sludge.
- C14. Feedstocks for AD inevitably contain plant or animal pathogens (such as Salmonella) and parasites (such as Cryptosporidium) to different degrees in different materials. Precautions are therefore needed in AD projects, especially CAD projects which involve transporting residues from various sources to a central point, which could lead to cross-contamination unless appropriate preventative measures are taken. Mesophilic AD will reduce pathogens and bacteria, but will not eliminate them from waste. Thermophilic digestion will further reduce the levels, but cannot guarantee total removal.
- C15. After any necessary pre-treatment, the waste is fed into a digester tank. The contents are then mixed thoroughly, either mechanically or by pumping gas through suitably located tubes inside the tank. Digesters are usually operated at temperatures of 35°C or 55°C. The rate at which the digestate breaks down through microbial action increases with temperature. At the same time, the survival rate of pathogens such as Salmonella reduces significantly.
- C16. After the AD process has taken place, the gas generated is collected in a storage tank, with any excess gas being flared off. The contents of the digester will be a mixture of solids and liquids (digestate solids and digestate liquor), which might be suitable for beneficial use as fertiliser or soil conditioner (subject to legislation), or will otherwise require disposal.
- C17. In 'sequential batch' digesters, the tank is loaded with the feedstocks (farm slurry etc), AD proceeds and the residues (i.e. the digestates) are then removed to make way for a new load. This method is often used in small-scale digestion schemes, such as those on individual farms. Larger scale digesters often employ a 'continuous feed' system in which the incoming feedstock is fed into the tank while an equivalent volume of processed waste is drawn off. The transport implications of peak movements need to be borne in mind for sequential batch digesters.

#### **Gas collection and use**

- C18. The gas collected through the AD process is primarily a mixture of methane (typically 65% of the total) and carbon dioxide (typically 35%). Trace gases are also produced, including hydrogen sulphide.

- C19. The gas is collected at the top of the digester and piped to a holding tank. Because this tank will have a finite storage capacity, a flare stack is often located nearby to dispose of any excess gas. The gas can be used:
- as a heating fuel for nearby buildings and for the generation of electricity;
  - in a range of industrial applications;
  - for the drying or incineration of sludge at sewage works; and,
  - to heat the digester itself and to power associated machinery.

The gas can also be bottled, after cleaning, for use as a domestic fuel or to power vehicles.

### **Other products**

- C20. As well as biogas, two other important by-products of AD are liquors and solid organic materials. The digestate liquor is a nitrogen rich fertiliser and is generally used on the farms on which it was produced. A potentially wider market has yet to be fully developed, although some AD schemes have successfully bottled and sold the liquor as a liquid fertiliser. Solid organic materials that have undergone incomplete digestion can either be used without further pre-treatment as a soil conditioner or further processed to yield agricultural compost which can be an effective substitute for peat.
- C21. When heavy metals and other potentially toxic materials have been removed from MSW it is possible to complete the stabilisation of the digestate solids by composting. The treated product can then be used as a soil conditioner, an organic mulch or for use in land reclamation. If, however, the digestate solid contains significant amounts of heavy metals and toxins, disposal to landfill will be necessary. In such cases reference should be made to the appropriate waste management licensing controls and legislation.

### **Digestion equipment**

- C22. An anaerobic digestion plant typically comprises a digester tank, buildings to house ancillary equipment such as a generator, a biogas storage tank, a flare stack and associated pipework. Plants can vary in scale from a small scheme treating the waste from an individual farm, or a medium-sized centralised facility dealing with wastes from several farms, to a sizeable industrial plant handling large quantities of MSW.
- C23. Digestion takes place in a tank, which is usually cylindrical or egg-shaped. The size of the tank will be determined by the projected volume and nature of the waste to be handled and the temperature and retention time in the digester. Some indicative tank dimensions are given in table 1. Digesters with a volume of less than 250m<sup>3</sup> can operate successfully on farms. Whereas most tanks are constructed

from glass-coated steel, these small digesters are often made of glass fibre-reinforced plastic.

### **Gas handling equipment**

- C24. The collection, movement and storage of gas will require a range of equipment, including pipework and valves, flame traps, condensate traps, flare stacks and control and monitoring equipment. In some cases gas needs to be treated, necessitating the addition of extra plant such as filters and de-misters.
- C25. The flare stack used for burning off surplus gas comes in two basic types:
- high level stacks, typically 6m to 10m high with a small diameter; and
  - low level stacks, typically 3m high with a larger diameter.

The flare stack can be enclosed in an open-topped cylinder to provide visual concealment and heat insulation.

### **Plant containment**

- C26. The ground around tanks and in waste reception areas is usually paved and bunded (surrounded by a barrier) to prevent pollution from the accidental discharge of spilled wastes. A collection system will often be installed within and around the plant to enable spilled waters to be collected and pumped either directly into the digester, or into a mixing tank used to increase the water content of solid waste.

### **Electricity and heat generation**

- C27. Biogas can be used to fuel a variety of electricity generation equipment, including spark ignition engines, dual fuel diesel engines and gas turbines. Biogas can also be used to supply heating systems (including that required to maintain the required temperature of the digester), or combined heat and power (CHP) schemes. For small schemes such as farm digesters, the energy can be used to heat the domestic water supply and central heating system. For larger systems, the gas can also be used to heat buildings outside the digestion site.

### **Sewage gas**

- C28. Anaerobic digesters installed at municipal sewage works typically range in volume from 180m<sup>3</sup> to 3,400m<sup>3</sup>. The tank can be as high as 15 metres, although it can sometimes be partly buried. In addition to reducing the visual impact, partial burial offers heat insulation benefits and so reduces the energy demand of the digestion process.

### **Landfill gas**

- C29. Most landfill sites containing biodegradable organic matter will produce landfill gas (LFG) through a complex process of microbial decomposition. The period of time over which LFG is actively produced will vary according to local conditions. Under favourable conditions, substantial gas generation from a large municipal landfill site would probably be complete within 25-30 years. However, many factors control the decomposition process, including the proportion and nature of the organic material in the waste, moisture content, temperature, acidity, and the design and management of the site. These in turn affect the quantity and composition of gas produced.

### **Gas collection and management**

- C30. Many landfill sites are already equipped with LFG collection and control systems to prevent the gas from dispersing. The gas is piped to an extraction plant on the edge of the landfill site. The plant will typically include:
- gas conditioning equipment;
  - extraction pumps;
  - a flare stack;
  - pipework and valves; and
  - control and monitoring equipment.
- C31. Gas is drawn from the waste via vertical and/or horizontal wells, each of which is monitored and regulated. It is then conveyed to the extraction plant, usually in polyethylene pipes placed underground. LFG comes out of a landfill site warm and saturated with moisture. As it cools in the extraction pipework, liquid condenses out. The pipework is therefore laid at a gradient and incorporates condensate traps to remove this liquid from the gas flow. The type of gas conditioning equipment required depends on the use to which the gas will be put: gas for heat generation does not need to be purified as much as that used for electricity generation.
- C32. At any landfill site a flare stack is required to mitigate emission of methane, which will be generated regardless of whether there is energy recovery or not. Where engines are installed the flare will be used where there is excess production or during servicing. In visual terms, flares can be either open (where a luminous flame will be observable) or closed (where the flame will be shrouded).

### **Electricity Generation**

- C33. LFG can be used to generate electricity via a number of generation systems, including spark ignition gas engines, dual fuel engines (in conjunction with diesel) and gas turbines. These technologies are now very well established. There is also the potential to generate electricity from landfill gas using fuel cells, but this is less well established at present.

- C34. The electricity generation plant tends to be located at or near the landfill site to minimise the need to pipe the gas over great distances. The generation equipment is usually integrated with the gas extraction plant, in a compound typically 25m x 25m in size.
- C35. The degree of shelter required depends on the type of equipment installed. The gas extraction pumps and conditioning equipment might be in the open air, under an open sided roof, or in a building along with the generator. Most engines with their generators are supplied in weatherproof prefabricated containers (typically 3m high, 2.5m wide and 10m long), which are fixed onto a concrete plinth. Transformers, switchgear, control panels and instrumentation are housed away from any gas handling plant in separate rooms or buildings.

### **Direct-End Use**

- C36. The direct use of LFG as a replacement fuel for coal, oil or natural gas is well established. The gas is pumped direct to a nearby end user, mainly to provide heat in industrial processes such as:
- firing and drying – as in brick and cement manufacture, stove drying and asphalt coating; and
  - boiler firing – to raise steam and heat water for the drying and bleaching of textiles and paper, the heating of commercial greenhouses, and for food processing.
- C37. Direct end-use systems usually comprise a pressure booster station, a pumping main and the utilisation equipment. The booster station will normally be integrated with the extraction plant. Pumping mains will be placed underground, and tend not to exceed 5 km in length because of the high cost of installation. The utilisation equipment varies greatly depending on the process, and because it will usually be integrated with the process, the impact in relation to planning requirements will be lessened.

## **PLANNING ISSUES**

### **Anaerobic digestion**

#### *Site selection, Transport and Traffic*

- C38. Many AD plants will be located close to the waste source. Small digesters on farms can sometimes be accommodated quite satisfactorily within the existing complex of farm buildings. Sewage sludge digesters are likely to be built in conjunction with new or existing wastewater treatment works, and will be less noticeable amongst the array of tanks and ponds performing other treatment functions than as a plant in isolation.

- C39. Centralised AD facilities (CAD plants) handling large quantities of agricultural wastes, sewage sludge or MSW may be more economically viable for the plant operators, but have the potential to raise more complex siting issues. The most acceptable sites are likely to be beside existing industrial or wastewater treatment works or, in the case of digestion schemes using MSW, in close proximity to a landfill site or waste transfer station.
- C40. Transport movements at on-farm digesters are not likely to add significantly to the impact of normal farm activities. By comparison, CAD plants will draw traffic to their central location as feedstock is delivered and products are distributed. The impact of these transport movements can be minimised by carefully considering fuel supply logistics, thereby reducing the distances travelled between the feedstocks, storage tanks, digester and local markets.

*Feedstocks and Product Storage*

- C41. Planning permission may be given to a scheme specifying a certain feedstock and in these circumstances the feedstock will not be able to be changed without the further planning consent. The appropriate authorities should be consulted early in the process when considering waste handling issues and classifications.
- C42. The storage of farm slurry is covered by the Control of Pollution (Silage, Slurry and Agricultural Fuel Oil) Regulations (Northern Ireland) 2003 and the Nitrates Action Programme Regulations (Northern Ireland) 2006, which specify minimum standards relating to the design, construction and operation of any farm slurry storage system. Storage facilities will also be needed for the processed fibre. The market is seasonal, so storage could be needed for up to six months output. Liquors can be stored on the farm, or at a CAD plant. Once cooled, they can be stored in lagoons or large tanks. For CAD sites, liquid storage facilities will need bunding around storage silos.

*Odour*

- C43. The AD of organic materials is, by its very nature, an odorous process. Predicted odour effects and proposed mitigating measures such as odour control systems should be examined. If a location is considered to be sensitive to odour nuisance, the Department will seek information from the developer to ensure that all possible sources of odour are accounted for in the proposals for odour control.
- C44. Odour may arise from:
- waste input storage bays: this is especially important during the summer, when the breakdown of organic material can begin before it is even collected for disposal;
  - sorting and mixing plant: here the waste is sorted or mixed with digestate prior to digestion;
  - the digester: although this is sealed during use, this will release odours when opened to allow cleaning; and

- digestate draw-off and de-watering plant: digested material is significantly less odorous than raw organic material, but can still give off unpleasant smells.

It should however be noted that AD can bring benefits in terms of odour reduction. The digestion of slurry, for example, is significantly less odorous than the common practice of storing slurry in pits.

#### *Emissions to Ground and Watercourses*

- C45. Serious farm pollution incidents can occur through the leakage or run-off of raw agricultural wastes. The AD of farm waste should reduce the likelihood and capacity of the material to pollute controlled waters. By following the Department of Agriculture and Rural Development Code of Good Agricultural Practice for the Prevention of Pollution of Water, Air and Soil, emissions to ground and watercourses should be minimised.

#### *Emissions to Air*

- C46. The production and use of biogas through AD results in a number of emissions to air, including those from gas vents, engine exhausts and flare stacks. These emissions are generally minor and are unlikely to present any significant environmental problem, provided the equipment meets relevant design specifications and is properly serviced. The Department's Environment and Heritage Service (EHS) will apply Integrated Pollution Control regulations to larger plant which will control emissions; this will apply to larger on-farm schemes as well as CAD plants.

### **Sewage gas**

#### *Site selection, Transport and Traffic*

- C47. In general terms, sites for sewage digestion plant will be influenced by the presence of a suitable wastewater treatment plant. At a site-specific level the location of the sludge digesters is likely to be dictated by the constraints of other systems to which they are linked at a treatment works. It is sometimes the case that some sludge is transported to wastewater treatment plants by tanker, and therefore there may be some local variation in siting in relation to the logistics of sludge transportation.

#### *Feedstocks and Product Storage*

- C48. Sewage sludge is not generally stored in liquid form for extended periods of time. There are however usually intermediate storage tanks which act as buffers for variations in flow or input from sludge tankers.

#### *Odour*

- C49. Given that sewage sludge digesters are normally located at wastewater treatment works, odour emissions are likely to be dominated by the primary treatment processes (settlement/aerobic treatment), which usually take place in open tanks.

*Emissions to Air, Ground and Watercourses*

- C50. Issues will be broadly the same as those described under anaerobic digestion. They are likely to be addressed as part of the collection of operations of a wastewater treatment works.

**Landfill gas**

*Site selection*

- C51. LFG plant should be located away from housing and other sensitive land uses, for reasons of safety and amenity. In practice this separation will rarely be difficult to achieve, given the large scale of landfill sites and the fact that they are generally situated away from residential areas.
- C52. The visual impact of a landfill gas generation scheme may be relatively insignificant if it is co-located with other activities such as waste disposal on a site adjacent to a completed landfill. If, alternatively, extraction and landfill works have ended and the site is undergoing restoration, the Department may wish to consider the need for mitigating measures to reduce any visual intrusion caused by the plant.

*Odour and emissions*

- C53. The statutory definition of the combustion process specifies that “fuel” does not include gas produced by the biological degradation of waste”. As such, the emissions from typical LFG plant are not currently regulated. Landfill gas fuelled generators may be regulated under EU stationary engines regulations in the near future. This is expected to result in a tightening of emissions limits.

**INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

**Anaerobic digestion**

- C54. A planning application for an anaerobic digestion plant could usefully include the following:
- site plan and elevation drawings to help determine visual impact;
  - photomontage of digester, plant building(s) and chimney stack with clear indication of building material;
  - information on grid connection works, including transformer and transmission lines;
  - details of emissions to air and an assessment of their impact;
  - details of vehicular access and vehicular movement;
  - landscaping provisions;
  - site management measures during the construction phase;
  - model of emissions dispersion; and,
  - community consultation plans.

### **Sewage gas**

- C55. An application for a sewage digestion plant could, in addition to the above, include reference to the existing wastewater treatment plant.

### **Landfill gas**

- C56. An application for a landfill gas plant could, in addition to the information listed above, note that the LFG plant would require the addition of a powerhouse to a typical landfill site.

### **Environmental Impact Assessment**

- C57. Developments that use waste to produce energy may require EIA. Such projects could fall within projects listed in Schedule 2.3 and/or 2.11 to the Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999.

### **OTHER AUTHORISATIONS/CONSENTS**

- C58. Dependent upon the level of energy generation and the details of the facility, the operations may require any of the following authorisations/consents:
- Abstraction License
  - Pollution Control
  - Waste Management License

## D. Energy from Waste (Thermal processes)

### INTRODUCTION

- D1. There are various technological configurations adopted to extract energy from waste. These can be broadly subdivided into thermal and biological processes. This section relates to the thermal processes, which use a high temperature process to release the chemical energy in the fuel.
- D2. This section offers guidance on types of thermal plant used to extract energy from the biodegradable fraction of waste. It discusses their main characteristics, the basic technology and their environmental implications. The Government Renewables Obligation Order definition is adopted here as the definition of what constitutes renewable energy in relation to energy from waste, and this is defined below.

### Municipal Solid Waste

- D3. Municipal solid waste (MSW) is the term used to describe those wastes gathered from domestic and commercial premises by the local waste collection authority. The quantity of MSW available is broadly proportional to the population of an area, but its composition will be affected by local factors such as the method of waste collection and the extent of waste recycling.

### Business waste

- D4. Non-hazardous industrial and commercial waste arisings in the UK have been estimated to be around 25 million tonnes per year, consisting mostly of paper, cardboard, wood and plastics. The disposal route for the bulk of this waste is landfill, although a small amount is incinerated along with MSW. In general, non-hazardous business waste can be preprocessed in similar ways to MSW to enable combustion using a range of technologies.

### Other relevant wastes

- D5. The main types of other wastes suitable for energy from waste schemes are as follows:
- Sewage sludge:** in 1999 (latest available figures) the UK produced 1.13million tonnes of sludge (dry solids). This corresponds to an average of about 20kg generated by each person and may be considered for combustion or other thermal processes for the disposal of this material.
- Wood processing waste:** small quantities of processed wood waste are produced by the furniture industries and can be classed as renewable, in their uncontaminated form.

### **Waste arisings and collection**

- D6. The source and collection method of the waste material affects the scope for using it in energy generation. MSW arisings are spread through an area, and are collected by local authorities or their contractors and taken to disposal sites. Other wastes arise at specific locations and lend themselves to small-scale energy schemes. There are economies of scale with larger more centralised plants.

### **Implications of the Renewables Obligation**

- D7. The Renewables Obligation Order (Northern Ireland) 2006 states that only electricity derived from 'biomass' will be eligible for Renewable Obligation Certificates (ROCs). 'Biomass' is defined here as a fuel of which at least 98% of the energy content is derived from plant or animal matter or substances derived directly or indirectly there from (whether or not such matter or substances are waste) and includes agricultural, forestry or wood wastes or residues, sewage and energy crops.
- D8. A generating station which is fired wholly or partly from waste is excluded from receiving ROCs unless:
- the only fuel is biomass in accordance with the above definition; or
  - advanced conversion technologies (e.g. pyrolysis and gasification) are used to produce a fuel gas, in which case ROCs can be claimed for the biomass fraction of the fuel. This is an incentive for the development of new technology which is inherently cleaner and can be deployed on a smaller scale.
- D9. In accordance with this definition, conventional waste incinerators firing MSW will not be able to claim ROCs for the electricity they generate. Only those installations eligible for ROCs are counted as renewable energy generation in the context of this document. Any firing of non-biomass waste will result in the plant being subjected to far more stringent controls, which needs to be borne in mind when considering MSW as a fuel.

### **TECHNOLOGY**

- D10. Conventional incineration and the advanced technologies defined in the Renewables Obligation above are the two technology routes most likely to be used to recover energy from solid waste in the short to medium term. The provisions of the Renewables Obligation may increase substantially the numbers of Energy from Waste installations using advanced processes in the future.

### **Direct combustion**

- D11. The majority of MSW incinerators burn the waste stream essentially in the form it is collected. This process is called direct combustion. The combustion gases are cleaned in a sequence of processes which remove particulates, acid gases and trace organic compounds. The ash exits the process as two distinct streams – bottom ash that falls from the combustion grate, and fly ash that is separated from the flue gases. Bottom ash is considered to be inert and, after the separation of metals, is either taken to general landfill or used as aggregate. Fly ash can contain heavy metal contamination and so should be disposed of in a controlled landfill.

### **Pyrolysis**

- D12. In recent years the concepts of waste pyrolysis and gasification have received considerable attention and a number of companies are offering systems for commercial installation. Pyrolysis is the process of heating fuel in the absence of air to produce charcoal and a gaseous fuel ('syngas'). These can then be burned in boilers, engines or turbines to generate heat and power. Plants with pyrolysis only are less common than those where pyrolysis is combined with gasification.

### **Gasification**

- D13. Gasification is a process of partial combustion, which enables operators to effectively control the temperature of the process, with consequent mitigation of pollutants. A gas is formed when the fuel reacts with sufficient oxygen to maintain a high reaction temperature but with insufficient oxygen to complete combustion. This gas can then be used in engines, boilers or turbines to generate power.
- D14. For all these processes the useful energy in the waste is generally released by combustion, although increasingly syngas from pyrolysis and gasification is being used as a source of hydrogen for fuel cells. In the context of fuel cells, pyrolysis and gasification as processes have the advantage of producing a homogeneous gas from which hydrogen can be extracted.
- D15. Pyrolysis and gasification are still developing but experience thus far has demonstrated that the superior control of the combustion offered by these processes can create much lower levels of contaminants in the exhaust gas when compared with typical grate combustion. Pyrolysis and gasification systems can generally be implemented at smaller scales than conventional incineration, making them more flexible in meeting the needs of smaller communities, and reducing local air quality impacts through minimisation of waste transportation. The ash resulting from pyrolysis and gasification followed by combustion has also been found to be more stable and less polluting than that from conventional incineration.

- D16. Waste can be pre-treated in a variety of ways to improve its combustion efficiency and extract recyclable materials such as metal and glass. Treatments include shredding, sorting and separation, and drying. The equipment used for sorting waste will typically include rotating and vibrating screens, magnetic separators, air separators and manual picking belts. Some more innovative systems use high temperature washing. The pressure from recycling targets will mean that all MSW plant will have extensive materials recovery facilities.

### **Combined Heat and Power**

- D17. The most efficient Energy from Waste schemes generate both electricity and heat, through Combined Heat and Power (CHP) plants. This method is particularly beneficial as most of the energy in the waste can be put to good use and the improvement in energy efficiency leads to a corresponding reduction in emissions. It is desirable for CHP and Community Heating Schemes to be situated close to local energy users in order to minimise the costs of the heat distribution system.
- D18. A typical waste-fuelled combined heat and power process will involve some or all of the following:
- waste reception and storage;
  - waste processing, material sorting and recovery;
  - feeding waste into the combustion, pyrolysis or gasification chamber;
  - the combustion, pyrolysis or gasification reactor itself;
  - generation of heat and power using steam turbines, gas engines or gas turbines;
  - treating the waste gases to reduce emissions;
  - handling, storage and disposal of ash; and,
  - handling, storage and disposal of liquid effluents such as boiler water and surface water.

### **Scale of development**

- D19. Energy from Waste plants vary in size from small installations (serving factories for example) to large-scale MSW plants. New projects therefore might either be accommodated within existing or converted buildings, or may require large new sites.
- D20. The costs of meeting stringent licensing standards mean that MSW plants using incineration need to achieve economies of scale to be viable. Incinerators in the UK have a waste throughput of in the region of 100,000 to 600,000 tonnes per year. A MSW plant consuming 400,000 tonnes of waste per year will produce approximately 34MW of electricity, enough to supply about 46,000 homes.

### **Disposal of ash and gas cleaning residues**

- D21. There are two types of ash from conventional incinerators. The ash that falls from the combustion grate (bottom ash) is inert and can be sent to normal landfill. The ash from the flue gas cleaning installation contains heavy metals and traces of other contaminants and should be sent to controlled landfill. The ash from gasification and pyrolysis plants may contain a higher carbon content but this is not thought to be harmful as the carbon is in its elemental form and inert. Heavy metals will still be found in the finer ash and may need disposal in controlled landfill. This will depend upon the process and appropriate treatment of this ash will be a condition of the licence to operate.

## **PLANNING ISSUES**

### **Siting issues**

- D22. The siting of an Energy from Waste plant is likely to be influenced by the following factors:
- the source of the waste;
  - the economic implications of transporting the waste;
  - site access; and,
  - proposed energy use, the availability of local heat markets and ease of connection to the electricity distribution network.
- D23. In general, waste treatment and disposal operations are characterised to a large extent by the high volume of materials entering and exiting the site. In order to minimise the adverse environmental effects of transporting waste, they should, wherever possible, be located close to the waste source. The optimum locations for most MSW and business waste plants are therefore likely to be in or very close to urban areas.
- D24. The Department will take into account the waste management plans being drawn up for the Region. These should identify the spare capacity at existing plants, sites for new waste management plants, or areas of search for new sites. They should also set out the land-use criteria against which planning applications for new waste management development will be assessed.

### **Visual Effects**

- D25. In many cases, Energy from Waste developments are likely to be proposed in industrial areas, where they will be broadly in keeping with the existing buildings. Even so, the developments can be prominent features, and therefore the Department will expect a high standard of design and landscaping in order to minimise their visual impact.
- D26. Chimney height will vary with the scale of plant and the technology used. Pyrolysis and gasification plant generally need significantly lower stack height than incineration. Chimney height will be determined by

pollution control procedures under the Pollution Prevention and Control Regulations (Northern Ireland) 2003 or the Clean Air (Northern Ireland) Order 1981, to ensure adequate dispersal of emissions in the exhaust gas.

### **Ambient air quality and odour**

- D27. A plant that complies with licence requirements for air pollution might still give rise to odours. For large projects such as MSW incinerators odour is covered under the IPPC authorisation, and for smaller projects it is covered under the local authority authorisation. The sources of odour nuisance may not always be emissions through chimneys and vents from the works, but could arise from open-air storage, handling or transport of waste materials or their products. In identifying sites for Energy from Waste plants in local plans and in considering planning applications for them, planning authorities will wish to bear in mind that some problems may be created by odour, particularly where a site is close to housing or other odour-sensitive land uses.

### **Dust**

- D28. Excluding particulates from stacks, most dust is created during waste processing and ash handling operations. Practical measures for dust control include minimising, or eliminating, open-air storage, water sprinkling and transportation within covered skips or lorries. Emission levels are regulated through the Department's Environment and Heritage Service (EHS) or the terms of a site's Waste Management Licence.

### **Emissions to water**

- D29. Water may be affected by certain liquid effluents created by particular processes. The main sources of liquid effluent will be from gas cleaning systems, cooling water and surface run off. EHS has responsibility for the control of water quality. The Department of Agriculture and Rural Development's Rivers Agency will need to be consulted if it is proposed that river water is used for cooling.

## **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

- D30. A planning application for a thermal Energy from Waste plant could usefully include the following:
- site plan and elevation drawings to help determine visual impact;
  - photomontage of plant building(s) and chimney stack with clear indication of building material;
  - information on grid connection works, including transformer and transmission lines;
  - details of air and noise emissions and an assessment of their impacts;

- details of vehicular access and vehicular movement;
- landscaping provisions;
- site management measures during the construction phase; and,
- model of emissions dispersion.

### **Environmental Assessment**

- D31. Developments that use waste to produce energy may require EIA. Such projects could fall within projects listed in Schedule 2.3 and/or 2.11 to the Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999.

### **OTHER AUTHORISATIONS/CONSENTS**

- D32. Dependent upon the level of energy generation and the details of the facility, the operations require any of the following authorisations/consents:
- Waste Incineration Directive
  - Pollution Control
  - Ambient Air Quality/Odour

## **E. Small Hydro**

### **INTRODUCTION**

- E1. Hydropower is well developed in Great Britain, where most sites with a potential greater than 1MW have already been developed. However, there is the potential for the development of sites in Northern Ireland in the range of 100kW (0.1MW) to 500kW (0.5MW), and the possibility for a few sites of up to 1MW, which could be economically developed as grid connected schemes. In addition, there are a larger number of locations where smaller, domestic scale schemes in the range 10kW to 50kW could be developed. This section deals with smaller hydro schemes of up to 1MW.

### **TECHNOLOGY**

- E2. The technology for harnessing waterpower is well established. Water flowing from a higher to a lower level is used to drive a turbine, which produces mechanical energy. This mechanical energy is usually turned into electrical energy by a generator, or more rarely to drive a useful mechanical device.
- E3. The energy produced is directly proportional to the volume of water and the vertical distance it falls. Thus, a similar amount of energy could be produced from a small volume of water falling over a long vertical distance (high head), as from a larger amount of water falling a much shorter vertical distance (low head).
- E4. The majority of schemes will be 'run of river', where water is taken from a river from behind a low weir, with no facility for water storage, and returned to the same watercourse after passing through the turbine. In addition, there is some potential for small hydro installed on existing reservoirs, but these may also be treated as 'run of river', as they do not involve the construction of a new impounding structure.
- E5. Pumped storage schemes are capable of being used in conjunction with more intermittent forms of renewable energy to smooth out the intermittency by providing an element of energy storage. During periods of low demand, but when the prime resource is available, excess energy is used to pump water from a lower level to a higher level reservoir. During periods when demand is high and the prime resource availability is low, the water from the higher reservoir is released via a turbine to the lower reservoir to generate electricity. Such schemes may require the construction of two new reservoirs, but apart from this, the technology employed, and the implications for the planning system, are similar to those outlined in this section. However, because of the cost involved, pumped storage schemes of less than 1MW are likely to be extremely rare.

- E6. The essential elements of a hydro scheme are as follows:
- a source of water that will provide a reasonably constant supply. Sufficient depth of water is required at the point at which water is taken from the watercourse, and this is achieved by building a low weir (typically around 2 metres high) across the watercourse. This is called the 'intake';
  - a pipeline, often known as a penstock, to connect the intake to the turbine. A short open 'headrace' channel may be required between the intake and the pipeline, but long headrace channels are rare due to environmental and economic constraints;
  - a building housing the turbine, generator and ancillary equipment – the 'turbine house'.
  - a 'tailrace' returning the water to the watercourse; and,
  - a link to the electricity network, or the user's premises.

These are explained below.

### **The Intake**

- E7. The scale and nature of these elements depend on site conditions, and whether the scheme is low head or high head.
- E8. The intake typically comprises a concrete or rubble masonry weir, up to 2 metres high, across the watercourse. A spillway ensures that the downstream watercourse is never totally deprived of flow, and a screen or trashrack prevents floating debris or fish from entering the pipeline. A valve or sluiceway is often incorporated, and where the watercourse has a high silt load, a settling tank may be required. The Department's Environment and Heritage Service (EHS), Land and Resource Management Unit should be consulted regarding disposal of debris from the trashrack.

### **The pipeline**

- E9. The pipeline (sometimes called the penstock) connects the intake with the turbine. This is typically a pipe of steel, plastic or composite material, the diameter of which could be between 10cm and 100cm, depending on the characteristics of the site, and the capacity of the scheme. High head schemes typically have smaller diameter pipes of longer length (sometimes over a kilometre), whereas low head schemes are typified by short, larger diameter pipes. Pipes are often buried for environmental or technical reasons. Anchor blocks to restrain the pipe are required at vertical and horizontal changes of direction, but these are usually buried if the pipe is buried.
- E10. Open headrace channels are now rare on new schemes, but may occur if the project involves the rehabilitation of an existing scheme, particularly on old watermill sites.

### **The turbine house**

- E11. The building houses the turbine, generator and ancillary equipment, and is typically a single storey building of between 3 metres by 4 metres for a small domestic scheme, to 10 metres by 10 metres for a large grid connected scheme. Occasionally, particularly on old watermill sites, the machinery may be located in an existing building. Vehicular access to the turbine house is required for construction and maintenance purposes.
- E12. To minimise the length of the tailrace, and to maximise the available head, the turbine house is usually located close to the watercourse.

### **The tailrace**

- E13. After use, the water is returned to the natural watercourse via a concrete or masonry channel connecting the turbine house to the watercourse. To avoid flooding the turbine, this channel should have a gradient sufficient to allow free discharge of water. A screen to prevent the ingress of fish is often incorporated, and occasionally the tailrace is an underground structure.

### **Electricity connection**

- E14. The connection between the turbine house and the local electricity network is typically 3 wires, supported on single wooden poles.

### **The context**

- E15. High head hydro sites require a significant fall and a significant proportion of river flow. Development is therefore likely to take place in hilly or mountainous areas, many of which may be of landscape or nature conservation interest. This can be a potential barrier to small hydro development although careful consideration of all the benefits and disbenefits of a development is required. Small hydro schemes are costly to build and the scale of the development must be consistent with the amount of energy produced. The developer therefore needs to make the best use of any site in terms of water abstraction. EHS Water Management Unit will put stringent controls on the water abstraction regime, particularly where nature conservation interests are evident, and negotiations are required between all parties at an early stage in order to reach an acceptable solution.
- E16. The built elements of small hydro schemes are small and usually of a scale in keeping with the river valleys in which they are sited.

### **PLANNING ISSUES**

- E17. The development of hydro-electric power generation schemes should be achieved in a manner which is compatible with the many other uses

to which a river is put. Early liaison between the developer, and the relevant statutory undertakers is essential to ensure that all statutory remits are met, and that proposals do not detract from the existing value and interest of the watercourse and its surroundings. There is some potential for environmental improvements through technical measures.

### **Siting and the landscape**

- E18. As with several renewable sources of energy, it is usually only possible to exploit hydropower resources where they occur. Hydro schemes do however enjoy modest locational flexibility as the precise siting of the intake and the turbine house can sometimes be influenced by non-operational factors, including local landscape characteristics.
- E19. Consideration should be given to integrating a new scheme into the landscape as far as possible. Where rivers are lined with trees, for instance, it will be relatively simple to conceal hydropower facilities, particularly if the existing woodland cover is supplemented by new planting. Where the development is taking place in a more open location, built elements should either be designed to be as small as possible, having regard to operational considerations, or should be designed to be in keeping with local landscape and architectural features. In the case of schemes proposed for hillsides or other prominent locations, the landscape impact of the development in close and distant views should be appraised. Careful consideration should be given to burying the pipeline and restoration of the pipeline route.
- E20. In some cases, the visual appearance of waterfalls may be affected by water abstraction. In these cases, consideration should be given to potential viewers, and to the importance of the waterfall in immediate and longer distance views. Assessment of effects can usefully include photographs of the waterfalls at various flows, as existing summer flows may match the proposed flows after abstraction during the wetter months. Measures could be adopted to overcome visual objections, such as requiring abstraction to be reduced during the day in summer months when visitors are most likely to be present.
- E21. Measures to minimise the visual impact of pipes and power lines should also be considered carefully at the design and planning application stages.

### **Design Considerations**

- E22. Although the hydro developments anticipated will generally be small in scale, their waterside location will, in many cases, place them in areas valued for their visual and natural amenity. Such schemes can operate for many decades, and their principal built elements will often become a permanent feature in the landscape. In some circumstances, weirs,

fish ladders and turbine houses can become features of interest in their own right.

- E23. For these reasons, the Department will expect a high standard of design. Particular attention may need to be given to the architectural quality of built elements, the choice of building materials, and manner in which the development is integrated with its surroundings. Schemes that are in harmony with the surroundings, perhaps incorporating vernacular building materials and styles are to be encouraged.

### **Hydrological Considerations**

- E24. During operation of a small hydro scheme, water is abstracted over a short stretch of the river. Hydroelectric schemes do not pollute or consume water and usually return the supply to the channel from which it was abstracted. Water that has passed through a turbine is often improved by aeration and is free of debris.

### **Ecological Considerations**

- E25. The effect of water abstraction on the riverine ecology can be a concern, particularly in areas that are valued or designated for their ecological resource. However, the long-term impacts of 'run of river' schemes on rivers are largely unknown. Where ecological issues are considered to be important, liaison between the developer, EHS Natural Heritage and Water Management Unit, and the Department for Culture Arts and Leisure will help to establish the required environmental information to be provided at the planning application stage, and the potential impacts that are to be considered. This may include surveys of river corridor and river beds habitats, bryophytes, fish, invertebrates, amphibians, birds and mammals. The effects of changed flow regimes and water quality may need to be assessed. It is possible that impacts can be 'designed out' of the scheme with measures such as pulsed flow or seasonal operating of the plant.

### **Fisheries interests**

- E26. Concern has been expressed that fish, in some instances, have been killed or injured by hydropower schemes. This risk can be minimised by careful design and adjustment of the seasonal operating schedule of the plant. Some types of turbine (such as low to medium head crossflow designs) can oxygenate the river water and may thereby benefit the fish population. Where necessary, dams and weirs should include structures which allow free passage of migratory fish, and afford fish and other freshwater animals protection from the turbines while maintain flows.

### **Noise**

- E27. The noise emitted from a turbine will generally be well contained by the turbine house and not be heard more than a few metres away. If necessary, limits can be set on noise emissions if the site is close to residential properties, by way of a planning condition.

### **Construction disturbance**

- E28. In general, the construction impact of a hydro-power scheme will be no different to that of other developments of similar size. However, construction on or beside a river will often cause the water to become clouded with silt or mud. Before granting planning permission for a hydro project, the Department may, in consultation with EHS Water Management Unit and the Department of Agriculture and Rural Development's Rivers Agency, request that a developer specifies the site management measures that will be adopted to minimise this problem.
- E29. The construction of the pipeline and weir may have an impact on sensitive habitats. In this instance the developer may be required to submit a detailed construction specification, and in very important ecological areas, an officer from EHS may be required to be present on site during certain parts of the construction process. This can ensure that construction is carried out in a manner that is most sensitive to the ecology of the site.

### **Operational disturbance**

- E30. Once in operation, small hydro schemes require little maintenance. A weekly visit is usually all that is required, and a well-constructed remotely operated plant may demand less frequent visits. Depending on the design, daily cleaning of the trashrack may be required during autumn, but self-cleaning screens are increasingly common.

### **Recreation and Public Access**

- E31. A small hydropower scheme will have a negligible impact on public access, though fisheries interests or other users of the river might be affected. The pipeline route may often be designed to follow the route of an existing footpath alongside a river, but impacts will be confined to the construction stage of the project where temporary diversions or closure may be required.

### **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

- E32. A planning application for a hydro development could usefully include the following information:

- maps, diagrams and drawings showing the location and design of intake, pipeline, turbine and turbine house, weirs, tailrace and security fencing and lighting for urban schemes;
- details of air and noise emissions and an assessment of their impacts;
- photomontage of intake;
- grid connection works, including transformer and transmission lines;
- provision for fish passes (where required);
- details of vehicular access and vehicular movement;
- landscaping provisions; and,
- measures for management of the site during the construction phase and for long term maintenance.

### **Environmental Assessment**

- E33. The Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999 include “installations for hydroelectric energy production” within Schedule 2(3)(i). Those with a generating capacity of over 500kW (0.5MW) must be screened for the need for EIA. Where a screening opinion is required, Schedule 3 to the EIA Regulations provides selection criteria for screening Schedule 2 development.
- E34. An EIA is often required by EHS Water Management Unit as part of the application for an Abstraction Licence. Consultation between statutory agencies at the scoping stage will minimise duplication of effort. In many cases, one Environmental Statement will be sufficient for both purposes.

### **OTHER AUTHORISATIONS/CONSENTS**

- E35. In addition to planning permission, a hydro scheme may require any of the following authorisations.
- Abstraction License
  - Consent to work in a water course
  - Consent from the Department of Agriculture and Rural Development’s Rivers Agency for any discharge, structure or other development likely to affect flow in a watercourse

## **F. Active Solar (Photovoltaics)**

### **INTRODUCTION**

- F1. Active solar technology can be divided into two categories: Photovoltaic (PV) and Solar Water Heating (SWH). Solar PV is unique among renewable energy technologies in that in addition to generating electricity from daylight, it can also be used as a building material in its own right. PV can either be roof mounted or free-standing in modular form, or integrated into the roof or facades of buildings through the use of solar shingles, solar slates, solar glass laminates and other solar building design solutions.

### **TECHNOLOGY**

- F2. PV systems exploit the direct conversion of daylight into electricity in a semi-conductor device.
- F3. The most common form of device comprises a number of semi conductor cells which are interconnected and encapsulated to form a solar panel or module. There is considerable variation in appearance, but many solar panels are dark in colour, and have low reflective properties. Solar panels are typically 0.5 to 1m<sup>2</sup> having a peak output of 70 to 160 watts. A number of modules are usually connected together in an array to produce the required output, the area of which can vary from a few square metres to several hundred square metres. A typical array on a domestic dwelling would have an area of 9 to 18m<sup>2</sup>, and would produce 1 to 2 kW peak output.
- F4. Other forms of solar PV technology are becoming more common in the UK, such as solar tiles, which can be integrated into new buildings or refurbishments alongside conventional roofing tiles or slates. They have the aesthetic advantage of giving a roof a homogeneous appearance, virtually indistinguishable from conventional roofing materials. PV modules can be fitted on top of an existing roof using a low support structure. In this case, the panels will typically lie flush with the existing roof and not protrude above the roofline. Alternatively, and particularly in new buildings, they may form all or part of the weatherproofing element of the roof, replacing conventional slates or tiles. Where the modules form only part of the area of the roof, they can be integrated in a similar way to proprietary skylights.
- F5. Connections between individual panels are made either in the support structure, or inside the roof void, and are rarely visible from the exterior of the building.

### **Siting issues**

- F6. For best performance, PV modules need to be inclined at an angle of 20-40 degrees, depending on the latitude, and orientated facing due south. In practical terms, this is not always possible on existing buildings, and some degree of flexibility in inclination and orientation is acceptable although this will be at the expense of best performance. To function well PV installations need to be inclined at between 10 and 60 degrees, and orientated facing from east to west (i.e. within 90 degrees of due south).
- F7. Although roof mounted PV is the most common, modules can also be mounted on the sides of buildings, or on free standing support structures on the ground. In some cases, particularly on institutional or commercial buildings, PV cladding on the side of the building can be an architectural feature as well as a supply of electricity. Other examples of building integrated PV include external sun shading of office windows (bris-solaires) and glass atrium roofs.
- F8. Shadows from buildings, trees or other structures can significantly reduce performance of the PV system and planners and designers should take reasonable steps to minimise permanent overshadowing of the PV.

### **Types of system**

- F9. **Stand-alone systems:** PV is widely used to provide power for communications systems, domestic dwellings and monitoring systems either in remote areas or locations where connection to the grid is expensive or otherwise problematic, e.g. certain road signage. Elsewhere in the UK, the use of PV to provide energy for lighting of telephone kiosks in rural areas, bus shelter lighting, remote traffic monitoring, and railway trackside signalling is increasing as it is almost always more cost-effective than new connections to the grid.
- F10. **Grid-connected schemes:** In grid-connected solar PV systems Northern Ireland Electricity (NIE) Supply business offer a Sell and Buy Back Contract that enables NIE to offer small generators a payment for both the NIROCs (Northern Ireland Renewable Obligation Certificates) on accredited generation and for electricity that is exported. Other contractual arrangements are available through Second Tier Suppliers. Further information is available on the NIE website <http://www.nie-yourenergy.co.uk/micro.php>.

### **The context**

- F11. PV technology is expected to decrease in cost over the next decade and PV systems could provide a useful contribution to renewable energy generation. To encourage greater uptake of renewable energy in Northern Ireland, the Government has announced proposed changes to the Building regulations to make micro-generation mandatory in new buildings from April 2008. For its part the

Department would encourage greater use of PV systems in new developments prior to this change in the Building Regulations coming into force, and will encourage the retrofitting or incorporation of such technology on existing buildings where appropriate. The current consultation on permitted development rights is aimed at assisting this.

## **PLANNING ISSUES**

### **General**

- F12. The technology will be familiar to most and from the planning point of view, whilst there are clearly implications for listed buildings and the sensitive front elevations of some conservation areas, in general 'solar panels' are to be encouraged. In many cases involving dwelling houses, provided the building is not a listed building, or in a conservation area and the installation complies with the relevant constraints, PV will be "permitted development" and is thus deemed not to require a planning application. Unless the panels are of an unusual design, they should not extend more than 15 centimetres beyond the plane of the existing roof slope for the purposes of Schedule 1 Part 1, Class B1(c) of the Planning (General Development) Order (Northern Ireland) 1993. The Department has also recently consulted about new permitted development rights for small scale renewable energy development associated with dwellinghouses.
- F13. PV is particularly well suited to the urban environment and is clean and silent in operation.
- F14. The increasing take-up of solar PV technologies raises a number of considerations which may need to be taken into account. These include:
- whether particular systems require planning permission;
  - the importance of siting systems in situations where they can collect the most energy from the sun;
  - the need for sufficient area of solar modules to produce the required energy output from the system;
  - the colour and appearance of the modules.

### **Listed buildings and designated areas**

- F15. The installation of a PV array on a building listed for its special architectural merit or historic interest – or on another building or structure within its curtilage – is likely to require an application for listed building consent. This will be so, even if specific planning permission is unnecessary.
- F16. Permitted development rights to clad the walls or alter the existing roofline of a dwelling do not necessarily apply in Areas of Outstanding Natural Beauty, Conservation Areas, Areas of Special Scientific

Interest, or the proposed Mourne National Park. When considering applications in these areas the potential impact on the character or appearance of the area should be considered.

- F17. If an application for a PV module is submitted for a building close to a conservation area, or close to a listed building, its proximity to such area or buildings may be a material consideration in deciding the application.

### **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

- F18. A planning application or application for listed building consent for a solar PV system could usefully include the following information:
- the design of the module or array;
  - photographs of the existing built environment;
  - detail of the roof mounting arrangement, if applicable;
  - indicative drawings of the module or array in place;
  - connection details to the building or grid if relevant;
  - if the application involves a listed building, a photomontage of the proposed collector array could be useful.

### **Environmental Assessment**

- F19. The Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999 do not include solar energy systems specifically in Schedule 1 or 2. However large, industrial scale developments (producing over 0.5MW of electricity) are listed in Schedule 2 and would therefore require a Screening Opinion. These, however, are rare in the UK. Domestic or small-scale systems are not covered by Schedule 1 or 2 and are therefore not likely to require an EIA. In AONBs, conservation areas and on listed buildings, the only issues likely to be important are visual amenity and building fabric and these can be covered by a short description accompanying the planning application.

### **Other Authorisations/Consents**

- F20. For stand-alone systems not connected to the distribution network, no additional authorisations are required. For systems that are connected to the electricity network, prior consent of NIE must be obtained in accordance with NIEs current connection process. Small PV systems come within the scope of Engineering Recommendation G83/1 – *Recommendations for the Connection of Small Scale Embedded Generators (up to 16A per phase), in Parallel with Public Distribution Networks*, (Issue 1: 2003). NIE have increased the limit of G83 applications to 6kW per phase. Larger systems may be required to meet Engineering Recommendation G59/1/NI – *Recommendations for the connection of embedded generating plant to Northern Ireland Electricity's distribution systems*.

## **G. Solar Thermal (Solar Water Heating)**

### **INTRODUCTION**

- G1. Active solar technology can be divided into two categories: Photovoltaic (PV) and Solar Water Heating (SWH). The technologies appear to be similar, in that they both use roof mounted equipment to collect radiation from the sun and convert it to a useful form of energy, but they produce two different things: electricity in the case of PV and hot water in the case of Solar Water Heating. This section deals with Solar Water Heating, and describes the basic technology and applications. Some sections are common to both sections: the repetition between them is intentional.
- G2. Solar water heating systems can be used to heat water for a variety of purposes. Amongst the most common are domestic use, light industrial and agricultural use and the heating of swimming pools. At present, the widest use is in the residential domestic hot water sector. SWH systems are occasionally used to provide space heating.
- G3. There is a common misconception that solar water heating is ineffective in the UK for climatic reasons. Whilst it is clearly not as effective in the UK as it could be in Spain for instance, a good modern system will make a significant contribution to water heating requirements. The domestic sector is an obvious priority – a well-designed system should provide 50–60% of annual domestic hot water requirements, with most of this energy capture being between May and September.

### **TECHNOLOGY**

- G4. The key component in a solar water heating system is the collector. Two main types are common in the UK: flat plate collectors and evacuated tube collectors. In both types, radiation from the sun is collected by an absorber, and is transferred as heat to a fluid, which may be either water, or a special fluid employed to convey the energy to the domestic system using a heat exchanger.

#### **Flat plate collectors**

- G5. Flat plate collectors comprise a water filled metal 'envelope' with a special black coating which improves absorption of solar energy and heat transfer. This is housed in a glazed, insulated box. The collector is connected to the hot water system of the building in a similar way to a conventional boiler, usually using an indirect coil in the hot water cylinder. Water is circulated either by thermo-syphon or, more commonly using a circulating pump. The pump is controlled in such a way that when the temperature of the collector is lower than the temperature in the hot water system, the pump is switched off. Flat plate collectors need to be protected against frost, and this is effected

either by the addition of antifreeze to the heating circuit, or by arranging the system such that the collector 'drains down' when the pump is switched off.

- G6. A type of flat plate collector has the storage cylinder as an integral part of the collector, mounted on the roof. Although common in warmer climates these are rare in the UK, and normally the only part of the installation that is visible is the collector.

### **Evacuated tube collectors**

- G7. Evacuated tube collectors comprise a number of vacuum tubes, typically around 100mm in diameter, and 2 metres in length containing a finned metal collector tube. Each tube is filled with a heat transfer fluid, and the upper ends of individual tubes are connected to a manifold heat exchanger, which is connected to the hot water system of the building as in the case of flat plate collectors. Evacuated tube collectors do not require protection against frost.
- G8. Although both types of collector will collect more energy during summer months, a significant amount of energy will also be collected on cold winter days, and evacuated tube collectors are more effective in doing this.

### **Installation**

- G9. The collector, together with the glazing and insulation are generally mounted in a box which is usually coloured grey or black, typically of 1-2m<sup>2</sup> in area. For an average residential domestic installation, some 4 or 5m<sup>2</sup> of flat plate collector, or some 3m<sup>2</sup> of evacuated tube are required. Typically, this would be mounted on a southerly facing roof pitch, or more rarely on a free-standing tilted frame on the ground, or a flat roof. Increasingly, collectors are becoming available that can be incorporated into a new or existing roof in much the same way as proprietary roof windows. Some systems use photovoltaics (PV) to provide power for the system pump. In this case, a separate PV module, typically 20cm by 40cm will be mounted adjacent to the solar hot water collector.
- G10. Collectors rarely project more than 120mm above the existing roofline. Connecting pipework is normally run from the back of the collector directly through to the roof void, and is not normally visible from the exterior of the building. 11. Solar water heating collectors for swimming pools generally comprise a mat of neoprene, or other black rubberised material that is mounted near to the swimming pool. Typically this will have an area of about half that of the surface area of the pool. The collector may be mounted on the roof of an adjacent low building (such as a garage), or more commonly on a low ground mounted frame. The collector is often mounted flat, or only slightly inclined with the outlet higher than the inlet.

### **Siting issues**

- G11. For best performance, solar water heating collectors need to be inclined at an angle of 30-40 degrees, depending on the latitude, and orientated facing due south. In practical terms, this is not always possible on existing buildings, and some degree of flexibility in inclination and orientation is acceptable although this will be at the expense of best performance. To function satisfactorily collectors can be inclined at between 10 and 60 degrees, and orientated facing from east to west (i.e. within 90 degrees of due south).
- G12. Although roof mounted collectors are the most common, they can also be mounted on the sides of buildings, or on free standing support structures on the ground. The latter is particularly common in the case of swimming pool heaters.
- G13. Shadows from buildings, trees or other structures can significantly reduce performance of solar hot water collectors, and planners and designers should take reasonable steps to minimise overshadowing.

### **The context**

- G14. Solar water heating is a mature and recognised technology. A domestic system is within the economic means of many households in the UK, and the technology could provide a useful contribution to renewable energy generation. To encourage greater uptake of renewable energy in Northern Ireland, the Government has announced proposed changes to the Building regulations to make micro-generation mandatory in new buildings from April 2008. For its part the Department would encourage greater use of SWH systems in new developments prior to this change in the Building Regulations coming into force, and will encourage the retrofitting or incorporation of such technology on existing buildings where appropriate. The current consultation on permitted development rights is aimed at assisting this.

## **PLANNING ISSUES**

### **General**

- G15. The technology will be familiar to most and from the planning point of view, whilst there are clearly implications for listed buildings and the sensitive front elevations of some conservation areas, in general 'solar panels' are to be encouraged. In many cases involving dwelling houses, provided the building is not a listed building, or in a conservation area and the installation complies with the relevant constraints, SWH will be "permitted development" and is thus deemed not to require a planning application. Unless the panels are of an unusual design, they should not extend more than 15 centimetres

beyond the plane of the existing roof slope for the purposes of Schedule 1 Part 1, Class B1(c) of the Planning (General Development) Order (Northern Ireland) 1993. The Department has also recently consulted about new permitted development rights for small scale renewable energy development associated with dwellinghouses.

- G16. Solar hot water systems have some advantage over other renewable energy technologies, in that they are well suited to the urban environment: they are silent in operation and release no emissions.
- G17. The development of systems for collecting and using solar energy raises a number of considerations which may need to be taken into account. These include:
- whether particular systems require planning permission;
  - the importance of siting systems in situations where they can collect the most energy from the sun;
  - the need for sufficient area of solar modules to produce the required energy output from the system;
  - the colour and appearance of the modules.

#### **Listed Buildings and designated areas**

- G18. Installation of solar water heating collectors on a building listed for its special architectural merit or historic interest – or on another building or structure in its curtilage – is likely to require an application for listed building consent. This will be so, even if specific planning permission is unnecessary.
- G19. Permitted development rights to clad the walls or alter the existing roofline of a dwelling do not necessarily apply in Areas of Outstanding Natural Beauty, Conservation Areas, Areas of Special Scientific Interest, or the proposed Mourne National Park. When considering applications in these areas the potential impact on the character or appearance of the area should be considered.
- G20. If an application for a SWH system is submitted for a building close to a conservation area, or close to a listed building, its proximity to such area or buildings may be a material consideration in deciding the application.

#### **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

- G21. A planning application or application for listed building consent for a solar hot water system could usefully include the following information:
- the design of the collector;
  - photographs of the existing built environment;
  - detail of the roof mounting arrangement, if applicable;
  - indicative drawings of the collector in place;
  - if the application involves a listed building, a photomontage of the proposed collector could be useful.

### **Environmental Assessment**

- G22. The Planning (Environmental Impact Assessment) Regulations (Northern Ireland) 1999 do not include solar energy systems specifically in Schedule 1 or 2. However large, industrial scale developments (producing over 0.5MW of electricity) are listed in Schedule 2 and would therefore require a Screening Opinion. These, however, are rare in the UK. Domestic or small-scale systems are not covered by Schedule 1 or 2 and are therefore not likely to require an EIA. In AONBs, conservation areas and on listed buildings, the only issues likely to be important are visual amenity and building fabric and these can be covered by a short description accompanying the planning application.

### **Other Authorisations/Consents**

- G23. No other authorisations are required.

## **H. Ground, Water and Air Source Heat Pumps**

### **Ground Source Heat Pumps**

#### **INTRODUCTION**

- H1. The average ground temperature just below the surface in the UK is between 8°C and 13°C and this temperature remains constant throughout the year. Ground source heat pumps (GSHP) are a means of tapping into and utilising this resource. GSHP were invented more than 50 years ago, and continuous development has greatly improved their efficiency and reliability. It is now a proven, cost-effective, safe and environmentally friendly alternative to fossil fuels that is cost-effective for certain commercial and domestic applications, particularly where mains gas is not available.
- H2. The market for GSHP is currently small but growing – they are currently more common in the USA and the rest of Europe. The principal market for GSHP are domestic housing, commercial properties not connected to the natural gas network, and commercial industrial properties with stable heat demand. It is estimated that there is the potential for the number of installations to increase.
- H3. GSHP are most likely to be an option where there is no access to natural gas and so the alternative may be oil or direct electric heating (storage heaters). Heat pumps ground loops can be laid in the ground or in water such as rivers, lakes or ponds.

#### **TECHNOLOGY**

- H4. To access thermal energy, coils or loops of special grade pipe need to be buried in the ground either in horizontal trenches or vertical boreholes. Horizontal trenches are a cheaper option and generally used where there is sufficient space. Where there is not enough land to do horizontal trenches, vertical boreholes can be used, these normally require to go down at least 60 meters and are the more expensive option, but will provide higher efficiencies since the temperature of the earth is higher at greater depths, and less power is needed to pump the fluid around the circuit. The length and size of ground loops is designed to match the heating needs of the property. The trenches or boreholes required for the ground loops can be dug and backfilled by a standard earth excavator.
- H5. Systems operate by circulating water (or another fluid) through pipes buried in the ground. The water in the pipes is lower than the surrounding ground and so it warms up slightly. This low grade heat is transferred to a heat pump, which raises the temperature to around 50°C. The heat pumps typically providing 4 units of energy from 1 unit of electricity.

- H6. The building plot will need sufficient land available for installation of the ground works. The dimensions of trenches or boreholes will vary between manufacturers. The ground above where heat pipes are installed can be used for open space or covered over with hard materials. Where there are existing lakes or ponds or where it is proposed to install Sustainable Urban Drainage Systems (SUDS), the opportunity to install ground source heat pumps beneath the surface of the water should be considered. Similarly in larger developments with open space requirements, ground source heat pumps could be laid beneath green spaces.

### **PLANNING ISSUES**

- H7. Any enlargement, improvement or other alteration to a dwelling house, or the provision, alteration or improvement of any building or enclosure within the curtilage of a dwellinghouse, required to facilitate heat pump development may be permitted development under Schedule 1 Part 1 Classes A and D of the Planning (General Development) Order (Northern Ireland) 1993. However, heat pumps are considered to be plant and machinery and where all or part of the equipment is not installed within an existing dwellinghouse or building permitted under the existing Part 1, could require a planning application. The Department has recently consulted about new permitted development rights for small scale renewable energy development associated with dwellinghouses. The definition of development also includes 'engineering operations'. Examples of activities held to fall within the definition of engineering operations include drilling of exploratory bore holes. Although, it should be noted that following the drilling and installation of heat pumps the ground can be returned to the previous state.

### **Archaeology**

- H8. As the installation of ground source heat pumps will require the excavation of trenches or deep boreholes it is important to consider in advance whether archaeological remains exist on the development site and what the implications of the development might be. The needs of archaeology and development can usually be reconciled, and much potential conflict reduced. Further details on archaeology can be found in Planning Policy Statement 6, Planning, Archaeology and the Built Heritage. Information on the location of scheduled monuments, and other known archaeological sites or areas with archaeological potential is held by the Department's Environment and Heritage Service (EHS) Built Heritage.

### **Contamination**

- H9. Applicants should be aware that the construction or extraction of a borehole or well for the purpose of abstraction, or the abstraction or

discharge to the water environment may require an authorisation from EHS Water Management Unit. Applicants should contact EHS for further details. Care should be taken when constructing boreholes to prevent contamination of the borehole itself and of the groundwater resource in general.

### **Water Source Heat Pumps**

- H10. Water source heat pumps operate in a similar way to ground source heat pumps. The loop is submerged in water, typically a river or lake. They take heat from the water and convert it into a gas. The gas is condensed in a process which releases heat. This heat can be transferred to the heat distribution system in the building. The use of a water source such as a river or lake is likely to provide lower efficiencies due to the temperature of the source being more affected by the weather, but the advantage is the relatively cheaper installation cost achieved by avoiding any ground works. Authorisation may be required from the Department of Agriculture and Rural Development's Rivers Agency.

### **Air Source Heat Pumps**

- H11. Air source heat pumps, are often used in moderate climates, they use the difference in outdoor and indoor air temperatures to cool and heat the building. Air source heat pumps extract the heat in air and use a fan to draw air over coils that extract energy. This energy is then transferred to a home or building and used as part of a heating supply. Although they are less efficient than ground source heat pumps, and likely to be more variable because air temperatures fluctuate both daily and seasonally. Even when the outside temperature drops, air source heat pumps can still produce 2-3 times as much energy as they use to run. However in cold weather the evaporator coil is likely to need defrosting. The air source heat pump does have advantages in terms of lower installation costs and the fact that no ground loop negates the need for trenching.
- H12. Air source heat pumps can be used for a wide variety of applications such as cooling for lofts, restaurant kitchens and hotel plant rooms where the hot water can easily be used for other applications. They can provide hot water using waste heat in the air. By using waste heat, they can also remove heat from an area, such as a loft space, where it is not needed.
- H13. Air-source heat pumps can be located in the roof space or on the side of the building. They look like air conditioning boxes. Where these are proposed for listed buildings or in conservation areas, it will be important that they are sensitively designed and sited.



## **ANNEX 2 - Passive Solar Design**

The advice and guidance contained within this annex should be read in conjunction with Policy RE2 Integrating Renewable Energy and Passive Solar Design.

### **INTRODUCTION**

1. Passive Solar Design (PSD) has always been a feature of traditional vernacular architecture. A blend of intuition and experience ensured that domestic scale buildings captured maximum light and heat from the sun whilst being positioned in the landform to act as a buffer against the worst of the elements.
2. PSD is an environmentally benign approach to building design which allows significant lifetime savings in energy to be made without initial or running costs. As such it should be regarded as the most basic starting point onto which energy efficiency and active renewable energy measures should be added. PSD does not result in any environmental impacts but reduces those which will inevitably arise as the consequence of the occupation and use of a building for any particular purpose.
3. PSD needs to be considered at the design stage as it provides effectively a one-off opportunity to save energy during the lifetime of a building, generally at no cost. In modern housing up to 20–25% of heating and lighting energy can be saved by the application of PSD principles.
4. When PSD is applied in conjunction with other technologies as part of a low or zero energy approach, the resulting buildings can be novel or unusual and this can create interesting and varied layouts and townscape. In the case of offices or public buildings such as schools, features with a PSD function such as ventilation stacks and atria can be incorporated in ways that add interest and character.
5. However, it is very important to realise that PSD principles can be applied equally effectively in housing and commercial developments which have an entirely conventional appearance. For example, a vernacular farmhouse could provide a useful design checklist: orientation towards the south, main living room windows in the south façade with splayed side reveals to maximise light penetration, possibly a long north sloping roofline down to single storey rooms at the rear of the house accommodating the kitchen, larder and few small windows.

### **TECHNOLOGY**

6. Virtually all buildings enjoy free energy and light from the sun; the objective in PSD is to maximise this benefit by using simple design approaches which intentionally enable buildings to function more

effectively and provide a comfortable environment for living or working. It is acknowledged that not all aspects of PSD are of direct concern to Planning Control, for example the use of dense materials to store heat.

7. An important distinction must be drawn between the use of PSD in housing and other buildings. In housing the primary objectives are to capture light and heat. In the case of other buildings light is also important but generally excess heat is a problem during periods of high solar gain, making the main purpose of PSD the removal of excess heat whilst avoiding the use of air conditioning.

### **Tool kit**

8. The items in the PSD 'tool kit' include:
  - **Orientation** – The capture of solar gain can be maximised by orientating the main glazed elevation of a building within 30 degrees of due south. In urban situations this generally results in an east-west street pattern. Orientation is important for housing and schools, which can make effective use of solar heating and daylight. Using dense materials in construction will enable the building to absorb heat during the day and release it slowly at night.
  - **Room layout** – Placing rooms used for living and working in the south facing part of the building, and locating storage, kitchens, bathrooms, toilets, stairways and the main entrance on the north side will make most effective use of solar heat and light.
  - **Avoidance of overshadowing** – Careful spacing of buildings should seek to minimise overshadowing of southern elevations, particularly during the winter when the sun is low. On sloping and wooded sites careful consideration must be given to siting to maximise solar access. It is possible to achieve high levels of natural light penetration with tight urban form but a balance has to be struck between height and shape of enclosing buildings and the width of intervening streets and spaces.
  - **Window sizing and position** – In housing, smaller windows should generally be used in north facing elevations. On the south elevation whilst larger windows increase solar gain this has to be weighed against greater heat losses in the winter and a risk of overheating in the summer. Sloping roof lights facing the sun will increase the solar radiation received. There are more benefits to be gained from reducing the size and number of north facing windows than by increasing south facing ones.
  - **Conservatories and Atria** – Carefully designed conservatories and atria can contribute to the management of solar heat and ventilation. To avoid problems of excessive heat gains and losses they should be designed and used as intermediate spaces located between the building and the external environment. Conservatories and atria can be designed to assist natural stack effect ventilation in the summer by drawing warm air upward to roof vents. They can also be used as heat collectors during the spring and autumn. The

net thermal benefits of conservatories will however be lost if they are artificially heated for use during the winter.

- **Natural ventilation** – This is particularly relevant to offices and public buildings such as schools. Atria and internal ventilation stacks projecting above the general roof level can be used to vent air as the building warms during the day, with cool air being drawn in through grilles in the building façade. This approach obviates the need for air conditioning (which can be up to four times more energy intensive than providing heating), and on occasions should make for a more healthy and pleasant building environment where measures may be necessary to counteract draughts and air pollution.
- **Lighting** – In offices the avoidance of deep-plan internal layouts and the use of atria, roof lights and light reflecting surfaces can help reduce the need for artificial lighting and should be used in conjunction with sensor controls.
- **Thermal Buffering** – In order to reduce heat losses, unheated spaces such as conservatories, green houses and garages which are attached to the outside of heated rooms can act as thermal buffers, the temperature of the unheated space being warmer than that outside.
- **Solar shading** – To reduce summertime overheating shading devices can be built into the building, for example overhanging eaves or projections above glazing. Alternatively solar shading can be provided by devices such as projecting blinds or brise soleil.
- **Landscaping** – Landscaping, including the use of earth bunds, is often used as part of an overall PSD approach providing a buffer against prevailing cold winds and shading for summer cooling.

### **Technical constraints**

9. PSD must form part of an holistic design approach to reduce the need for conventional energy sources in providing heating, light and ventilation and it should be used in conjunction with other low energy and efficiency measures.
10. The application of PSD may often be constrained to an extent by building and location specific factors. However at the present time the most significant barriers to its widespread application are lack of familiarity and a perception that PSD will inevitably produce buildings which are unconventional in appearance and difficult to market.

### **PLANNING ISSUES**

11. PSD is sometimes seen as straddling the boundary between the Building Regulations, which are concerned with energy efficiency standards and can have an influence on window size, and Planning Control which is concerned with siting, layout and appearance. Planning has an important role to play in encouraging the greater

application of PSD principles, particularly amongst house builders, and in the design of public buildings such as schools and some commercial buildings.

## **INFORMATION TO ACCOMPANY A PLANNING APPLICATION**

12. The following points should be used as a checklist when preparing a planning application.

### **Housing applications**

#### Siting and Layout

13. The potential benefits of PSD can only be realised by careful siting and layout design. Sites should be planned to permit good solar orientation to as many dwellings as possible:
  - the majority of residential access roads should predominantly run east-west with local distributors running north-south. This should allow one main elevation of the dwellings to face towards the south;
  - houses should be carefully placed to limit the extent of overshadowing. Taller buildings should be placed to the north of the site with lower and low density buildings to the south of the site. Overshadowing resulting from landform, trees and buildings outside the site needs to be avoided as far as possible. Staggering dwellings or using stepped facades can also be of benefit;
  - the majority of building facades should be set within 30 degrees of due south to enjoy the benefits of PSD; and
  - the latitude band for Northern Ireland is mostly between 54° to 55° north.

#### Land form and landscaping

14. Working with the landform, landscaping should seek to act as a barrier to cold prevailing winds.

#### Design and fenestration

15. Given an appropriate site layout, the nature of rooms and window sizing will also influence the extent of passive solar benefit:
  - in applying internal house layouts to the site, rooms which are occupied for much of the time (e.g. living rooms) should be positioned on the south side of the dwelling;
  - generally windows on the north side of the dwelling should be smaller and fewer in number than those on the south; and
  - garages and unheated conservatories can be used to provide thermal buffering on the north side of the dwelling but only if they are unheated.

### **Other buildings**

#### Lighting

16. The design should seek to make the best use of natural light by use of orientation and elements such as a shallow floor plan, atria and roof lighting.

#### Heating/Cooling

17. The design should avoid using excessive glazing that will lead to overheating during the summer. Overhanging eaves and shading features can be used to limit solar gain during the summer. Natural stack effect ventilation driven by solar design should be used in preference to air conditioning.

### **OTHER AUTHORISATIONS/CONSENTS**

18. PSD does not require any other consent beyond planning control. It may, however, also be relevant to the application of the Building Regulations.



# **ANNEX 3 - Community benefits arising out of the development of windfarms and other large scale renewable energy projects in Northern Ireland**

## **1. PLANNING AGREEMENTS**

### **To enable development to proceed**

- 1.1 Where a development would have implications for the public provision of infrastructure a developer may be required to make an in-kind or financial contribution towards its provision. It is possible that the development of a windfarm or other large scale renewable energy project would have such implications with the developer being required to enter into a legal agreement under Article 40 of Planning (Northern Ireland) Order 1991 in the provision of, for instance:
- road infrastructure improvements outside of the application site;
  - wildlife habitat management or creation in mitigation for adverse impacts of the construction; and/or
  - payments to overcome adverse implications for communication networks such as TV or radar.

### **Developer offers**

- 1.2 The developer might wish to volunteer “gains” beyond those matters that could be legitimately described as necessary for the development to proceed. Such “gains” could be offered as part of the planning process, or they could be undertaken as a separate exercise. The courts have held that this approach is not, in itself, unlawful. Whether the developer enters into an agreement with the Department or offers these extra benefits unilaterally, the important point here is that, as such offers are not necessary for the development to proceed, **they must not impact upon the decision-making process.**

## **2. COMMUNITY BENEFITS – OUTSIDE OF THE PLANNING PROCESS**

- 2.1 It is perfectly acceptable for a business to enter into a legally binding agreement with third parties to deliver particular and agreed benefits to the community. The Department would advocate this approach as it separates, more clearly, community benefits from the planning decision. It is important that the developer is able to identify suitable local representative people or organisations with whom it can negotiate. If there are funds to be administered then an appropriately constituted and regulated body must be identified or created.
- 2.2 Such benefits offered to local communities could take the form of one or more of:
- in-kind benefits such as the construction of a needed community facility;

- a lump sum financial payment for the benefit of the community;
- annual payments to the community; and/or
- a commitment from the developer to use local labour and/or contractors/services wherever possible.

- 2.3 It is, however, considered to be essential that:
- benefits are negotiated with appropriate and representative persons or bodies;
  - benefits are channelled through a regulated and properly constituted body or trust (this could include the local authority);
  - benefits are utilised for an agreed range of appropriate uses that would all fall within the definition of sustainable development;
  - at least part of any annual payment benefits should be invested in carbon; and
  - emissions reduction measures in the local community.
- 2.4 It must be clear that the provision of benefits is on a purely voluntary basis with no connection to the planning application process.

### 3. CASE STUDIES

- 3.1 Three case studies from Northern Ireland and other parts of the UK are presented in order to provide an idea of the range of options that might be available. The first case study is from Northern Ireland, the second from Wales, and the third from Scotland. The sums of money involved have been left out of most of the descriptions as this will need to be negotiated on a case by case basis. **Listing these examples does not indicate their endorsement or otherwise by the Department.**

- 3.2 **Altahullion Wind Farm – Renewable Energy Systems (RES) Group**  
Altahullion Wind Farm, between Dungiven and Limavady, began generating in 2003. The developers, RES Ltd and B9 Energy Services Ltd, designed a community fund in order that the wind farm could make a longer-term contribution to local community activities, promoting local social sustainability as well as global environmental sustainability. The Fund arrangements were included in the sale of Altahullion Wind Farm to the now owner RES-GEN Ltd, which has taken on responsibility for the Fund.
- 3.3 The Fund is divided equally between three community groups local to the wind farm, all of which are registered charities. The groups were chosen due to their proximity to the wind farm and following consultation with the local community and their representatives.
- 3.4 **Management of the Fund.** The arrangements for the Fund have been formalised in an agreement between Altahullion Wind Farm and the three groups. Subject to the terms and conditions in the agreement, Altahullion Wind Farm makes available the Funds to the community groups by way of one annual payment to each group in each of the nine years from 2004 to 2012 (inclusive). The company's obligation

to make each annual contribution is subject to the Funds not being used for any activity deemed to be for political or religious objectives or deemed to be adverse to the interests of the wind farm; and each community group receiving payment of the Funds not ceasing to function as a Community Group.

- 3.5 28 days before the payment date in each year, each of the community groups furnishes Altahullion Wind Farm with a receipts and payments document in respect of the application of the Funds during the previous year.
- 3.6 Examples of initiatives that the Fund has contributed towards to date include:
- Creation of a new community riverside pathway and footbridge
  - Entertainment activities for family fun days
  - Summer schemes for local children
  - Maintenance and running of community buildings

### **The Village of Carno, Powys**

- 3.7 The planning permission for Carno Windfarm included the offer of community benefits from the developer, Npower Renewables (formerly National Windpower). This was incorporated, along with payments initially linked to bio-diversity monitoring, into a “section 106” obligation and the annual payments have been administered by the two local community councils. This is not untypical of many wind farms in Wales.
- 3.8 **Management of the Trust.** The Fund is managed by an Executive Committee who under the terms of the constitution of the Trust are also the members of Carno Community Council. The constitution, which is recognised by the Charity Commissioners, sets out how the Trust will operate in terms of members, co-opting people, financial regulations, what can and cannot be done to enhance the status of the fund. There is also a set of rules which in summary, deny grants to political organisations, for repairs or the purchase of second-hand equipment but otherwise any one who lives in the Carno electoral district can apply with each case treated on its merits. The Trustees meet approximately once a month to consider applications. These are co-ordinated through an administrator who vets the application to ensure all correct documentation and information has been supplied in support of the application. In recognition of the agreement with Npower Renewables, the Trust and individual recipients of grants do have to agree to co-operate with any publicity that might be requested. The Trustees organise an annual press event at which the work of the Fund is promoted.
- 3.9 **The Grants Awarded.** A total of 113 grants have been awarded, the majority of those made to individuals having been for educational purposes. The Fund does have a policy of making a payment to all

students from Carno who have been accepted at universities/colleges and this also applies to those undertaking nursing and other courses relevant to the furtherment of an individual's career. Help has also been given to members of the Young Farmers Club to attend international rallies, and to the WI who send members on courses at Denham College.

- 3.10 The Fund has also been, and remains, very sympathetic to the needs of the local school which has been helped through grants to improve the facilities it can offer. The prime example of this was a grant towards a computer suite. This has in turn made it possible to run a range of adult computer courses in the evening, and the Trust helped individual attendees with a contribution towards their registration fees. The football and bowls clubs have received grants for new equipment and facilities and more recently grants from the Trust have helped the formation of very successful Gardening and Quilting Clubs. The grants helped them overcome the burden of their initial set up costs.
- 3.11 The Community Centre has also benefited from the Trust. A good example has been grants towards the costs of ensuring the catering facilities are of the highest standard. This is important to the Centre as a large proportion of the income it raises itself is through the offering of a conference/meeting venue which is able to cater for delegates. The Trust paid for a Food and Hygiene course that ensured the people providing the catering held the relevant certificates. A regular contribution is made to a club that helps Carno senior citizens through the provision of a place to meet and through the arranging of excursions.
- 3.12 Energy Issues. A more recent development has been the establishment of the Mid Wales Community Energy Trust, which has strong links with Mid Wales Energy Agency but is a separate entity. The Community Energy Trust has been able to draw in funding from various sources (including Npower Renewables) and is proposing to set in train a "Green Village Project" utilising the skills of the Energy Agency to identify opportunities for energy efficiency and small-scale renewable energy developments in Carno and other local villages. Monies from the fund and other available sources will be used to help implement the identified projects. An important point here is that money from wind power developments is usually able to be used as match-funding for grants from other sources.

### **Protocol between ScottishPower and Argyll and Bute Council, Scotland**

- 3.13 The following concordat has been developed between the local authority and the developer. It is in addition to voluntary "community benefits" packages that have been subject to the Scottish equivalent of "section 106" obligations. The Council has resolved that community benefits packages for future developments will move away from a

reliance upon Town and Country Planning legislation and will establish community trust funds outside of the planning system. The partnership with ScottishPower is described in the following concordat:

Whereas:

- a) Argyll and Bute Council (“the Council”) have recognised the significant renewable energy resource within the region and wish to see this developed responsibly for the maximum long-term socio-economic benefit of the population of Argyll and Bute.
- b) ScottishPower have existing hydro and wind farm interests in Argyll with plans for further expansion in response to demand for renewable energy, and are also the current energy supplier to the Council (including 20% green energy).

Without prejudice to either party’s rights and interests, in whatever capacity, Argyll and Bute Council and ScottishPower have agreed to create a Strategic Partnership, which will be expanded to include other utilities and renewable energy companies at the request of such other utilities and renewable energy companies, to ensure that benefit from renewable energy developments are maximised locally through further renewable energy developments and energy efficiency measures. This partnership recognises the long-term relationship, which the Council wishes to have with ScottishPower and such other utilities and companies, ensuring the responsible harvesting of the full range of renewable energy resources in the longer term while maximising benefit to local communities and the local economy.

The Strategic Partnership between Argyll and Bute Council and ScottishPower will in the meantime co-ordinate activities for mutual benefit in the following key areas:

- i. The completion of a region-wide Renewable Energy Resource Assessment the remit of which will be drawn up in agreement between the two parties and other relevant partners. The Council will manage the assessment with input from ScottishPower in key areas of expertise.
- ii. The completion of a strategic site-selection study for tidal stream power to identify a suitable location for an early demonstration project, recognising the likely significant potential for this technology in the region. This will be led by ScottishPower with input and resources to be agreed from Argyll and Bute Council and other relevant bodies i.e. Scottish Natural Heritage (SNH).
- iii. In recognition of the vital role which the Argyll, Lomond and the Islands, Energy Agency (ALI Energy) currently plays in the promotion of renewable energy and energy efficiency, and its future potential role if adequately resourced, funding will be provided from ScottishPower for ALI Energy for an agreed scope of work to include renewable energy education with local

communities and other interested stakeholders. Likewise the Council will core fund ALI Energy at the existing level of funding support. Any alterations to this will require the prior authorisation of the Council's Strategic Policy Committee.

- iv. The exploration of the potential for an Argyll and Bute -wide fund which will draw resources from large-scale wind farm and other renewable energy developments in order to ensure that the entire community of Argyll and Bute benefits from renewable energy. This fund will help promote additional work through ALI Energy, in particular to facilitate small-scale renewable energy and energy efficiency projects within communities, along with the joint promotion of green energy measures to the domestic and business sectors.
- v. The co-ordination of all of the above with ongoing initiatives in sustainable energy in Argyll and Bute.

The above terms are indicative of the parties' intention to work together on renewable energy initiatives in Argyll and Bute in a spirit of partnership. Accordingly the terms shall not be legally binding upon the parties.

The duration of the Strategic Partnership shall be two years from the last date of signing unless terminated by either party giving to the other four weeks written notice of their intent to withdraw. The Partnership's success will be assessed at that time and if it has proven to be of mutual benefit, the partnership will be continued. For the avoidance of doubt, no legally binding partnership is being created.

## **ANNEX 4 – Stakeholder organisations**

The following is a list of the stakeholder that outside have assisted the Department in bringing forward Planning Policy Statement 18 Renewable Energy:

**Action Renewables**

**British Wind Energy Association**

**Community Technical Aid**

**Construction Employers Federation**

**Council for Nature Conservation and the Countryside**

**Friends of the Earth**

**Northern Ireland Authority for Utility Regulation**

**Northern Ireland Electricity**

**Northern Ireland Environment Link**

**Northern Ireland Local Government Association**

**The National Trust**

**The Royal Society for the Protection of Birds**

**Ulster Farmers Union**

**World Wildlife Fund Northern Ireland**



# **ANNEX 5 – Screening for Equality Impact Assessment Draft Planning Policy Statement 18 ‘Renewable Energy’**

## **Section 75 Equality of Opportunity Screening Analysis Form**

### **Section 1 – Policy to be Screened**

**1.1 Please insert below a brief description of the policy/legislation, including the title and all the main aims and objectives.**

**Title**

**[draft] Planning Policy Statement 18 ‘Renewable Energy’**

**Aims**

**The primary aim of this Statement is to encourage and facilitate the provision and siting of renewable energy generating facilities in appropriate locations within the built and natural environment. The main objectives behind the policies are:**

- to contribute to the alleviation of climate change through reducing greenhouse gas emissions;
- to contribute to the regional target of 12% of electricity generation by 2012, and 40% by 2025 from renewable energy sources;
- to assist the diversification of energy supply and a more competitive energy market;
- encourage economic growth and rural diversification associated with the development of an indigenous renewable energy industry;
- to ensure that the environmental, landscape, visual and amenity impacts associated with renewable energy development are adequately addressed;
- to ensure adequate protection of the Region’s built and natural, and cultural heritage features;
- to promote knowledge of and greater acceptance by the public of prospective renewable energy developments that are appropriately located;
- to foster greater community involvement in renewable energy projects and encourage use of community benefits; and
- promote greater application of the principles of Passive Solar Design in the design, siting and layout of new development.

**1.2 On whom will the policies/legislation impact? Please specify.**

The PPS will have direct implications for developers and applicants seeking planning permission for the development of renewable energy generating facilities. The provisions of the PPS will require all public sector development; large-scale urban development; and dwellings in

the countryside, to demonstrate what consideration has been given to the principles of Passive Solar Design.

**1.3 Who is responsible for (a) devising and (b) delivering the policy, eg is it DOE, a Whitehall Department or EU? What is the relationship and have they considered this issue and any equality issues?**

(a) DOE Planning and Environmental Policy Group in consultation with Interdepartmental Working Group and representative NGOs

(b) The Policy will be implemented through the development control process by those with responsibility for making planning decisions [normally] the DOE Planning Service, but also the Planning Appeals Commission.

**1.4 What linkages are there to other NI Departments/NDPBs in relation to this policy/legislation?**

The draft Planning Policy Statement has been prepared within the strategic context of international and national commitments on climate change and the reduction of greenhouse gas emissions; and in consultation with Interdepartmental Working Group and representative NGOs.

**1.5 What data are available to facilitate the screening of this policy/legislation?**

There are a variety of information sources that can be drawn upon on the Section 75 groups from the Northern Ireland Statistics and carried Research Agency (NISRA) and the Planning Service database of development decisions. No detailed analysis of this data has been out at this stage as there are no anticipated effects on equality.

**1.6 Is additional data required to facilitate screening? If so, give details of how and when it will be obtained.**

This is not anticipated at this stage.

## Section 2 – Screening Analysis

### 2.1 Is there any indication or evidence of higher or lower participation or uptake by the following Section 75 groups?

	Yes	No
Religious belief		✓
Political opinion		✓
Racial group		✓
Age		✓
Marital status		✓
Sexual orientation		✓
Gender		✓
Disability		✓
Dependants		✓

**Please give details.**

The Department considers there is no evidence that the draft Planning Policy Statement 18 Renewable Energy will have any differential impact on any of the groups within the Section 75 groups in relation to lower participation or take up. The Policy will be implemented through the development control process (see paragraph 2/3(b)).

### 2.2 Is there any indication or evidence that any of the following Section 75 groups have different needs, experiences, issues and priorities in relation to this policy issue?

	Yes	No
Religious belief		✓
Political opinion		✓
Racial group		✓
Age		✓
Marital status		✓
Sexual orientation		✓
Gender		✓
Disability		✓
Dependants		✓

**Please give details.**

The Department considers there to be no indication or evidence that any of the Section 75 groups have different needs, experiences, issues and priorities in relation to draft Planning Policy Statement 18 Renewable energy. The Planning Policy Statement will however have direct implications for developers and applicants seeking planning particularly for proposals involving Renewable energy technology.

**2.3 Have consultations with the relevant representative organisations or individuals within any of the Section 75 categories, indicated that policies of this type create problems specific to them?**

	<b>Yes</b>	<b>No</b>
Religious belief		✓
Political opinion		✓
Racial group		✓
Age		✓
Marital status		✓
Sexual orientation		✓
Gender		✓
Disability		✓
Dependants		✓

**Please give details of any consultations carried out, and any problems identified.**

It has not been considered necessary to date to consult with any of the Section 75 groups on this matter. However, as part of the public consultation exercise the document will be forwarded to relevant key groups in the Department's Equality Scheme.

**2.4 Is there an opportunity to better promote equality of opportunity or community relations by altering the policy, or by working with others, in Government, or in the larger community in the context of this policy?**

No

**Please give details.**

Not applicable.

**2.5 It may be that a policy/legislation has a differential impact on a certain Section 75 group, as the policy has been developed to address an existing or historical inequality or disadvantage. If this is the case, please give details below.**

Not Applicable.

**2.6 Please consider if there is any way of adapting the policy to promote better equality of opportunity or good relations. Please give details.**

Not applicable.

## Section 3 – EQIA Recommendation

- 3.1 Full EQIA procedures should be carried out on policies considered to have significant implications for equality of opportunity. Please fill in the following grid in relation to the policy/legislation.**

<b>Prioritisation Factors</b>	<b>Significant Impact</b>	<b>Moderate Impact</b>	<b>Low Impact</b>
Social Need.			✓
Effect on people's daily lives.			✓
Effect on economic, social and human rights.			✓
Strategic significance		✓	
Financial significance			✓

**Please give details.**

The varied nature of renewable energy technologies presents the potential to develop an indigenous renewable energy industry and provides a range of opportunities to support the local economy. In addition to the policy objectives of contributing to the strategic regional target in alleviating climate change through reducing greenhouse gas emissions by achieving 40% of electricity generation by 2025 from renewable energy sources, the PPS will have indirect implications in assisting the diversification of the Regions energy supply and a more competitive market.

- 3.2 In view of the considerations in Sections 2 and 3 do you consider that this policy/legislation should be subject to a full EQIA? Please give reasons for your considerations. If you are unsure, please consult with affected groups and revisit the screening analysis accordingly.**

The Department has concluded Planning Policy Statement 18 Renewable Energy does not have a significant adverse impact on any Section 75 group.

- 3.3 If an EQIA is considered necessary please comment on the priority and timing in light of the factors in table 3.1.**

Not applicable.

3.4 **If an EQIA is considered necessary is any data required to carry it out/ensure effective monitoring? Please give details.**

Not applicable.

<b>Main Groups Relevant to the Section 75 Categories</b>	
<b><u>Category</u></b>	<b><u>Main Groups</u></b>
Religious belief	Protestants; Catholics; people of non-Christian faiths; people of no religious belief
Political opinion	<b>Unionists generally; Nationalists generally; members/supporters of any political party</b>
Racial Group	White people; Chinese; Irish Travellers; Indians; Pakistanis; Bangladeshis; Black Africans; Black Caribbean people; people with mixed ethnic group
Gender	Men (including boys); women (including girls); trans-gendered people
Marital status	Married people; unmarried people; divorced or separated people; widowed people
Age	For most purposes, the main categories are: children under 18, people aged between 18-65, and people over 65. However, the definition of age groups will need to be sensitive to the policy under consideration
“Persons with a disability”	Disability is defined as: A physical or mental impairment, which has a substantial and long-term adverse effect on a person’s ability to carry out normal day-to-day activities as defined in Sections 1 and 2 and Schedules 1 and 2 of the Disability Discrimination Act 1995
“Persons with dependants”	Persons with personal responsibility for the care of a child; persons with personal responsibility for the care of a person with an incapacitating disability; persons with personal responsibility for the care of a dependant elderly person
Sexual orientation	Heterosexuals; bi-sexuals; gays; lesbians